

Superior Unified School District #15



Project Manual

For

John F. Kennedy Elementary School Campus Buildings - SFB 1001-1004 Roof Improvements


SFB Project No. 110215101-9999-016-BRG

July 6, 2020



ARCHITECHNOLOGY

5229 North 7th Avenue, Suite 101
Phoenix, Arizona 85013

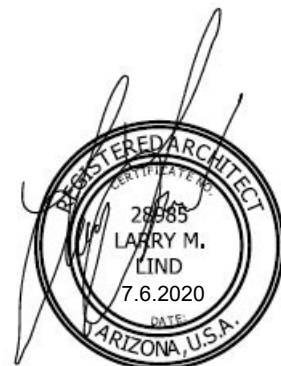

EXPIRES: 3-21-22

SECTION 00 01 10

TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS GROUP

Division 00 -- Procurement and Contracting Requirements

00 01 01 - Project Title Page

00 01 10 - Table of Contents

SPECIFICATIONS GROUP

GENERAL REQUIREMENTS SUBGROUP

Division 01 -- General Requirements

01 10 00 - Summary

01 20 00 - Price and Payment Procedures

01 30 00 - Administrative Requirements

01 40 00 - Quality Requirements

01 50 00 - Temporary Facilities and Controls

01 60 00 - Product Requirements

01 70 00 - Execution and Closeout Requirements

01 78 00 - Closeout Submittals

FACILITY CONSTRUCTION SUBGROUP

Division 02 -- Existing Conditions

02 22 50 – Interior and Partial Demolition

Division 06 – Wood, Plastics and Composites

06 10 00 – Rough Carpentry

Division 07 -- Thermal and Moisture Protection

07 55 00 – Modified Bitumen Roofing

07 62 00 – Sheet Metal Flashing and Trim

07 71 00 – Roof Specialties

07 90 05 – Joint Sealers

Division 09 -- Finishes

09 90 00 – Painting and coating

END OF TABLE OF CONTENTS



EXPIRES: 3-21-22

SECTION 01 10 00

SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: John F. Kennedy Elementary School Roof Improvements
- B. Owner's Name: Superior Unified School District #15
- C. The Project consists of the complete removal and replacement of the existing roof system at John F. Kennedy Elementary School.

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract.

1.03 DESCRIPTION OF ALTERATIONS WORK

- A. Scope of demolition and removal work is shown on drawings and specified in Section 02 25 50.

1.04 OWNER OCCUPANCY

- A. Owner intends to occupy the Project upon Substantial Completion.
- B. Cooperate with Owner to minimize conflict and to facilitate Owner's operations.
- C. Schedule the Work to accommodate Owner occupancy.

1.05 CONTRACTOR USE OF SITE AND PREMISES

- A. Provide access to and from site as required by law and by Owner:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 20 00

PRICE AND PAYMENT PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.

1.02 SCHEDULE OF VALUES

- A. Submit a printed schedule on AIA Form G703 - Application and Certificate for Payment Continuation Sheet. Contractor's standard form or electronic media printout will be considered.
- B. Submit Schedule of Values in duplicate within 15 days after date of Owner-Contractor Agreement, but must be approved before submission of first pay application.
- C. Revise schedule to list approved Change Orders, with each Application For Payment.

1.03 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Present required information in typewritten form.
- C. Form: AIA G702 Application and Certificate for Payment and AIA G703 - Continuation Sheet including continuation sheets when required.
- D. Execute certification by signature of authorized officer.
- E. Use data from approved Schedule of Values. Provide dollar value in each column for each line item for portion of work performed and for stored Products.
- F. List each authorized Change Order as a separate line item, listing Change Order number and dollar amount as for an original item of Work.
- G. Submit three copies of each Application for Payment.
- H. Include the following with the application:
 - 1. Any documents required by Owner as stipulated in the Conditions of the Contract.

1.04 MODIFICATION PROCEDURES

- A. Architect will advise of minor changes in the Work not involving an adjustment to Contract Sum or Contract Time as authorized by the Conditions of the Contract by issuing supplemental instructions on AIA Form G710.
- B. Construction Change Directive: Architect may issue a document, signed by Owner, instructing Contractor to proceed with a change in the Work, for subsequent inclusion in a Change Order.
 - 1. The document will describe changes in the Work, and will designate method of determining any change in Contract Sum or Contract Time.
 - 2. Promptly execute the change in Work.
- C. Proposal Request: Architect may issue a document which includes a detailed description of a proposed change with supplementary or revised Drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 14 days.
- D. Contractor may propose a change by submitting a request for change to Architect, describing the proposed change and its full effect on the Work, with a statement describing the reason for the change, and the effect on the Contract Sum and Contract Time with full documentation and

a statement describing the effect on Work by separate or other contractors. Document any requested substitutions in accordance with Section 01 60 00.

- E. Computation of Change in Contract Amount:
 - 1. For change requested by Architect for work falling under a fixed price contract, the amount will be based on Contractor's price quotation.
 - 2. For change requested by Contractor, the amount will be based on the Contractor's request for a Change Order as approved by Architect.
- F. Execution of Change Orders: Architect will issue Change Orders for signatures of parties as provided in the Conditions of the Contract on AIA G701.
- G. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Sum.
- H. Promptly revise progress schedules to reflect any change in Contract Time, revise sub-schedules to adjust times for other items of work affected by the change, and resubmit.
- I. Promptly enter changes in Project Record Documents.

1.05 APPLICATION FOR FINAL PAYMENT

- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Sum, previous payments, and sum remaining due.
- B. Application for Final Payment will not be considered until the following have been accomplished:
 - 1. All closeout procedures specified in Section 01 70 00.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 30 00

ADMINISTRATIVE REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preconstruction meeting.
- B. Progress meetings.
- C. Construction progress schedule.
- D. Submittals for review, information, and project closeout.
- E. Number of copies of submittals.
- F. Submittal procedures.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PRECONSTRUCTION MEETING

- A. Owner will schedule a meeting after Notice of Award.
- B. Attendance Required:
 - 1. Owner.
 - 2. Architect.
 - 3. Contractor.
- C. Agenda:
 - 1. Execution of Owner-Contractor Agreement.
 - 2. Submission of executed bonds and insurance certificates.
 - 3. Distribution of Contract Documents.
 - 4. Submission of list of Subcontractors, list of Products, schedule of values, and progress schedule.
 - 5. Designation of personnel representing the parties to Contract, Owner and Architect.
 - 6. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 - 7. Scheduling.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.02 PROGRESS MEETINGS

- A. Schedule and administer meetings throughout progress of the Work at maximum weekly intervals.
- B. Make arrangements for meetings, prepare agenda with copies for participants, preside at meetings.
- C. Attendance Required: Job superintendent, major Subcontractors and suppliers, Owner, Architect, as appropriate to agenda topics for each meeting.
- D. Agenda:
 - 1. Review minutes of previous meetings.
 - 2. Review of Work progress.

3. Field observations, problems, and decisions.
 4. Identification of problems which impede planned progress.
 5. Review of submittals schedule and status of submittals.
 6. Maintenance of progress schedule.
 7. Corrective measures to regain projected schedules.
 8. Planned progress during succeeding work period.
 9. Maintenance of quality and work standards.
 10. Effect of proposed changes on progress schedule and coordination.
 11. Other business relating to Work.
- E. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.03 CONSTRUCTION PROGRESS SCHEDULE

- A. Within 1 day after date of the Agreement, submit preliminary schedule defining planned operations for the first 60 days of Work, with a general outline for remainder of Work.
- B. If preliminary schedule requires revision after review, submit revised schedule within 5 days.
- C. Within 5 days after review of preliminary schedule, submit draft of proposed complete schedule for review.
 1. Include written certification that major contractors have reviewed and accepted proposed schedule.
- D. Within 5 days after joint review, submit complete schedule.
- E. Submit updated schedule every 30 days.

3.04 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
 1. Product data.
 2. Shop drawings.
 3. Samples for selection.
 4. Samples for verification.
- B. Submit to Architect for review for the limited purpose of checking for conformance with information given and the design concept expressed in the contract documents.
- C. Samples will be reviewed only for aesthetic, color, or finish selection.
- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below and for record documents purposes described in Section 01 78 00 - CLOSEOUT SUBMITTALS.

3.05 SUBMITTALS FOR INFORMATION

- A. When the following are specified in individual sections, submit them for information:
 1. Design data.
 2. Certificates.
 3. Test reports.
 4. Inspection reports.
 5. Manufacturer's instructions.
 6. Manufacturer's field reports.
 7. Other types indicated.
- B. Submit for Architect's knowledge as contract administrator or for Owner. No action will be taken.

3.06 SUBMITTALS FOR PROJECT CLOSEOUT

- A. When the following are specified in individual sections, submit them at project closeout:
 1. Project record documents.

2. Operation and maintenance data.
3. Warranties.
4. Bonds.
5. Other types as indicated.

B. Submit for Owner's benefit during and after project completion.

3.07 NUMBER OF COPIES OF SUBMITTALS

- A. Documents for Review:
 1. Small Size Sheets, Not Larger Than 8-1/2 x 11 inches: Submit the number of copies which the Contractor requires, plus two copies which will be retained by the Architect.
 2. Larger Sheets, Not Larger Than 36 x 48 inches: Submit the number of opaque reproductions which Contractor requires, plus two copies which will be retained by Architect.
- B. Documents for Information: Submit two copies.
- C. Documents for Project Closeout: Make one reproduction of submittal originally reviewed. Submit one extra of submittals for information.
- D. Samples: Submit the number specified in individual specification sections; one of which will be retained by Architect.
 1. After review, produce duplicates.
 2. Retained samples will not be returned to Contractor unless specifically so stated.

3.08 SUBMITTAL PROCEDURES

- A. Transmit each submittal with approved form.
- B. Sequentially number the transmittal form. Revise submittals with original number and a sequential alphabetic suffix.
- C. Identify Project, Contractor, Subcontractor or supplier; pertinent drawing and detail number, and specification section number, as appropriate on each copy.
- D. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction Work, and coordination of information is in accordance with the requirements of the Work and Contract Documents.
- E. Deliver submittals to Architect at business address.
- F. Schedule submittals to expedite the Project, and coordinate submission of related items.
- G. For each submittal for review, allow 15 days excluding delivery time to and from the Contractor.
- H. Identify variations from Contract Documents and Product or system limitations which may be detrimental to successful performance of the completed Work.
- I. Provide space for Contractor and Architect review stamps.
- J. When revised for resubmission, identify all changes made since previous submission.
- K. Distribute copies of reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with requirements.
- L. Submittals not requested will not be recognized or processed.

END OF SECTION

SECTION 01 40 00

QUALITY REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. References and standards.
- B. Quality assurance submittals.
- C. Mock-ups.
- D. Control of installation.
- E. Tolerances.
- F. Testing and inspection services.
- G. Manufacturers' field services.

1.02 SUBMITTALS

- A. Test Reports: After each test/inspection, promptly submit two copies of report to Architect and to Contractor.
 - 1. Test reports are submitted for Architect's knowledge as contract administrator or for the Owner, for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.
- B. Certificates: When specified in individual specification sections, submit certification by the manufacturer and Contractor or installation/application subcontractor to Architect, in quantities specified for Product Data.
 - 1. Indicate material or product conforms to or exceeds specified requirements. Submit supporting reference data, affidavits, and certifications as appropriate.
 - 2. Certificates may be recent or previous test results on material or product, but must be acceptable to Architect.
- C. Manufacturer's Instructions: When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, for the Owner's information. Indicate special procedures, perimeter conditions requiring special attention, and special environmental criteria required for application or installation.
- D. Manufacturer's Field Reports: Submit reports for Architect's benefit as contract administrator or for Owner.
 - 1. Submit for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.

1.03 REFERENCES AND STANDARDS

- A. For products and workmanship specified by reference to a document or documents not included in the Project Manual, also referred to as reference standards, comply with requirements of the standard, except when more rigid requirements are specified or are required by applicable codes.
- B. Conform to reference standard of date of issue current on date of Contract Documents, except where a specific date is established by applicable code.
- C. Obtain copies of standards where required by product specification sections.
- D. Maintain copy at project site during submittals, planning, and progress of the specific work, until Substantial Completion.

- E. Should specified reference standards conflict with Contract Documents, request clarification from Architect before proceeding.
- F. Neither the contractual relationships, duties, or responsibilities of the parties in Contract nor those of Architect shall be altered from the Contract Documents by mention or inference otherwise in any reference document.

1.04 TESTING AND INSPECTION AGENCIES

- A. Contractor shall employ and pay for services of an independent testing agency to perform other specified testing.
- B. Employment of agency in no way relieves Contractor of obligation to perform Work in accordance with requirements of Contract Documents.
- C. Contractor Employed Agency:
 - 1. Testing agency: Comply with requirements of ASTM E 329, ASTM E 543, and ASTM C 1077.
 - 2. Laboratory: Authorized to operate in Phoenix, Arizona.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

3.02 MOCK-UPS

- A. Tests will be performed under provisions identified in this section and identified in the respective product specification sections.
- B. Assemble and erect specified items with specified attachment and anchorage devices, flashings, seals, and finishes.
- C. Accepted mock-ups shall be a comparison standard for the remaining Work.
- D. Where mock-up has been accepted by Architect and is specified in product specification sections to be removed, remove mock-up and clear area when directed to do so.

3.03 TOLERANCES

- A. Monitor fabrication and installation tolerance control of products to produce acceptable Work. Do not permit tolerances to accumulate.

- B. Comply with manufacturers' tolerances. Should manufacturers' tolerances conflict with Contract Documents, request clarification from Architect before proceeding.
- C. Adjust products to appropriate dimensions; position before securing products in place.

3.04 TESTING AND INSPECTION

- A. See individual specification sections for testing required.
- B. Testing Agency Duties:
 - 1. Provide qualified personnel at site. Cooperate with Architect and Contractor in performance of services.
 - 2. Perform specified sampling and testing of products in accordance with specified standards.
 - 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
 - 4. Promptly notify Architect and Contractor of observed irregularities or non-conformance of Work or products.
 - 5. Perform additional tests and inspections required by Architect.
 - 6. Submit reports of all tests/inspections specified.
- C. Limits on Testing/Inspection Agency Authority:
 - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
 - 2. Agency may not approve or accept any portion of the Work.
 - 3. Agency may not assume any duties of Contractor.
 - 4. Agency has no authority to stop the Work.
- D. Contractor Responsibilities:
 - 1. Deliver to agency at designated location, adequate samples of materials proposed to be used which require testing, along with proposed mix designs.
 - 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
 - 3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
 - 4. Notify Architect and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
 - 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
 - 6. Arrange with Owner's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- E. Re-testing required because of non-conformance to specified requirements shall be performed by the same agency on instructions by Architect. Payment for re testing will be charged to the Contractor by deducting testing charges from the Contract Price.

3.05 MANUFACTURERS' FIELD SERVICES

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment, test, adjust and balance of equipment as applicable, and to initiate instructions when necessary.
- B. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

3.06 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not conforming to specified requirements.

- B. If, in the opinion of Architect, it is not practical to remove and replace the Work, Architect will direct an appropriate remedy or adjust payment.

END OF SECTION

SECTION 01 50 00

TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Temporary utilities.
- B. Temporary telephone service.
- C. Temporary sanitary facilities.
- D. Temporary Controls: Barriers, enclosures, and fencing.
- E. Security requirements.
- F. Vehicular access and parking.
- G. Waste removal facilities and services.
- H. Project identification sign.
- I. Field offices.

1.02 TEMPORARY UTILITIES

- A. Provide and pay for all electrical power, lighting, water, heating and cooling, and ventilation required for construction purposes beyond those made available by Owner.
- B. Existing facilities may be used.
- C. Use trigger-operated nozzles for water hoses, to avoid waste of water.

1.03 TELEPHONE SERVICE

- A. Provide, maintain, and pay for telephone service to field office if required at time of project mobilization.
- B. Telephone service may be provided through a mobile phone service.

1.04 TEMPORARY SANITARY FACILITIES

- A. Provide and maintain required facilities and enclosures. Provide at time of project mobilization.
- B. New permanent facilities may not be used during construction operations.
- C. Maintain daily in clean and sanitary condition.
- D. At end of construction, return facilities to same or better condition as originally found.

1.05 BARRIERS

- A. Provide barriers to prevent unauthorized entry to construction areas and to protect existing facilities and adjacent properties from damage from construction operations and demolition.
- B. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.

1.06 FENCING

- A. Provide 8-foot-high fence around construction site; equip with vehicular and pedestrian gates with locks.

1.07 EXTERIOR ENCLOSURES

- A. Provide temporary weather tight closure of exterior openings to accommodate acceptable working conditions and protection for Products, to allow for temporary heating and maintenance

of required ambient temperatures identified in individual specification sections, and to prevent entry of unauthorized persons. Provide access doors with self-closing hardware and locks.

1.08 SECURITY

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft.
- B. Coordinate with Owner's security program.

1.09 VEHICULAR ACCESS AND PARKING

- A. Coordinate access and haul routes with governing authorities and Owner.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Provide means of removing mud from vehicle wheels before entering streets.
- D. Provide temporary parking areas to accommodate construction personnel. When site space is not adequate, provide additional off-site parking.

1.10 WASTE REMOVAL

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- B. Provide containers with lids. Remove trash from site periodically.
- C. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- D. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

1.11 PROJECT IDENTIFICATION

- A. Provide project identification sign of design and construction indicated on Drawings.
- B. Erect on site at location indicated.
- C. No other signs are allowed without Owner permission except those required by law.

1.12 FIELD OFFICES

- A. Office: Weathertight, with lighting, electrical outlets, heating, cooling equipment, and equipped with sturdy furniture and drawing display table if required by the Owner.
- B. Provide space for Project meetings, with table and chairs to accommodate 6 persons.
- C. Locate offices a minimum distance of 30 feet from existing structures.
- D. District will provide a classroom space for a temporary field office. Contractor shall return the space to the district in the same or better condition upon completion.

1.13 REMOVAL OF UTILITIES, FACILITIES, AND CONTROLS

- A. Remove temporary utilities, equipment, facilities, materials, prior to Substantial Completion inspection.
- B. Clean and repair damage caused by installation or use of temporary work.
- C. Restore existing facilities used during construction to original condition.
- D. Restore new permanent facilities used during construction to specified condition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 60 00

PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General product requirements.
- B. Re-use of existing products.
- C. Transportation, handling, storage and protection.
- D. Product option requirements.
- E. Substitution limitations and procedures.
- F. Spare parts and maintenance materials.

1.02 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 EXISTING PRODUCTS

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by the Contract Documents.
- B. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the Owner, or otherwise indicated as to remain the property of the Owner, become the property of the Contractor; remove from site.
- C. Reused Products: Reused products include materials and equipment previously used in this or other construction, salvaged and refurbished as specified.

2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by the Contract Documents.
- B. Do not use products having any of the following characteristics:
 - 1. Made using or containing CFC's or HCFC's.
- C. Adhesives and Joint Sealants:
 - 1. Definition: This provision applies to gunnable, trowelable, and liquid-applied adhesives, sealants, and sealant primers used anywhere on the interior of the building inside the weather barrier, including duct sealers.
 - 2. Specific Product Categories: Comply with limitations specified elsewhere.

2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers: Use a product of one of the manufacturers named and meeting specifications, no options or substitutions allowed.
- C. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named.

2.04 SPARE PARTS AND MAINTENANCE PRODUCTS

- A. Provide spare parts, maintenance, and extra products of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION PROCEDURES

- A. Instructions to Bidders specify time restrictions for submitting requests for substitutions during the bidding period. Comply with requirements specified in this section.
- B. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents.
- C. A request for substitution constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
 - 2. Will provide the same warranty for the substitution as for the specified product.
 - 3. Will coordinate installation and make changes to other Work which may be required for the Work to be complete with no additional cost to Owner.
 - 4. Waives claims for additional costs or time extension which may subsequently become apparent.
- D. Substitutions will not be considered when they are indicated or implied on shop drawing or product data submittals, without separate written request, or when acceptance will require revision to the Contract Documents.
- E. Substitution Submittal Procedure:
 - 1. Submit three copies of request for substitution for consideration. Limit each request to one proposed substitution.
 - 2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
 - 3. The Architect will notify Contractor in writing of decision to accept or reject request.

3.02 TRANSPORTATION AND HANDLING

- A. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- B. Transport and handle products in accordance with manufacturer's instructions.
- C. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- D. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- E. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.

- F. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- G. Prevent contact with material that may cause corrosion, discoloration, or staining.
- H. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- I. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

SECTION 01 70 00

EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition.
- C. Cutting and patching.
- D. Cleaning and protection.
- E. Starting of systems and equipment.
- F. Demonstration and instruction of Owner personnel.
- G. Closeout procedures, except payment procedures.

1.02 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Cutting and Patching: Submit written request in advance of cutting or alteration which affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.

1.03 PROJECT CONDITIONS

- A. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- B. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere.
- C. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
- D. Pollution Control: Provide methods, means, and facilities to prevent contamination of soil, water, and atmosphere from discharge of noxious, toxic substances, and pollutants produced by construction operations.

1.04 COORDINATION

- A. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- B. Notify affected utility companies and comply with their requirements.
- C. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- D. Coordinate space requirements, supports, and installation of mechanical and electrical work which are indicated diagrammatically on Drawings. Follow routing shown for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.

- E. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- F. Coordinate completion and clean-up of work of separate sections.
- G. After Owner occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of Owner's activities.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 60 00.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.

- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.04 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
 - 1. Where openings in exterior enclosure exist, provide construction to make exterior enclosure weatherproof.
 - 2. Insulate existing ducts or pipes that are exposed to outdoor ambient temperatures by alterations work.
- C. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove rotted wood, corroded metals, and deteriorated concrete; replace with new construction specified.
 - 2. Remove items indicated on drawings.
 - 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- D. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
 - 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
 - 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. Provide temporary connections as required to maintain existing systems in service.
 - 4. Verify that abandoned services serve only abandoned facilities.
 - 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- E. Protect existing work to remain.
 - 1. Prevent movement of structure; provide shoring and bracing if necessary.
 - 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 - 3. Repair adjacent construction and finishes damaged during removal work.
 - 4. Patch as specified for patching new work.
- F. Adapt existing work to fit new work:
 - 1. Where removal of partitions or walls results in adjacent spaces becoming one, rework floors, walls, and ceilings to a smooth plane without breaks, steps, or bulkheads.
 - 2. Where a change of plane of 1/4 inch or more occurs in existing work, submit

recommendation for providing a smooth transition for Architect review and request instructions.

- G. Refinish existing surfaces as indicated:
 - 1. Where materials are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 - 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
 - 3. Patch as specified for patching new work.
- H. Clean existing systems and equipment.
- I. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- J. Do not begin new construction in alterations areas before demolition is complete.
- K. Comply with all other applicable requirements of this section.

3.05 CUTTING AND PATCHING

- A. Execute cutting and patching to complete the work, to uncover work in order to install improperly sequenced work, to remove and replace defective or non-conforming work, to remove samples of installed work for testing when requested, to provide openings in the work for penetration of mechanical and electrical work, to execute patching to complement adjacent work, and to fit products together to integrate with other work.
- B. Execute work by methods to avoid damage to other work, and which will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- C. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- D. Restore work with new products in accordance with requirements of Contract Documents.
- E. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- F. Refinish surfaces to match adjacent finish. For continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
- G. Make neat transitions. Patch work to match adjacent work in texture and appearance. Where new work abuts or aligns with existing, perform a smooth and even transition.

3.06 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas if materials fall into space during roofing activities and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.07 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.

- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle plastic coverings if possible.

3.08 STARTING SYSTEMS

- A. Coordinate schedule for start-up of various equipment and systems that were disassembled during roofing activities.
- B. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions which may cause damage.
- C. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- D. Verify that wiring and support components for equipment are complete and tested.
- E. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- F. Submit a written report that equipment or system has been properly installed and is functioning correctly.

3.09 DEMONSTRATION AND INSTRUCTION

- A. Demonstrate operation and maintenance of products to Owner's personnel two weeks prior to date of Substantial Completion.
- B. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shutdown of each item of equipment at scheduled time, at equipment location.
- C. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- D. Provide a qualified person who is knowledgeable about the Project to perform demonstration and instruction of owner personnel.

3.10 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.

3.11 FINAL CLEANING

- A. Use cleaning materials that are nonhazardous.
- B. Clean interior if required from roofing debris falling into space and exterior glass, surfaces exposed to view and stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- C. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- D. Clean filters of operating equipment.
- E. Clean debris from roofs, gutters, downspouts, and drainage systems.
- F. Clean site; sweep paved areas, rake clean landscaped surfaces.

- G. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.12 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
- B. Notify Architect when work is considered ready for Substantial Completion.
- C. Submit written certification that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Architect's review.
- D. Correct items of work listed in executed Certificates of Substantial Completion and comply with requirements for access to Owner-occupied areas.
- E. Notify Architect when work is considered finally complete.
- F. Complete items of work determined by Architect's final inspection.

END OF SECTION

SECTION 01 78 00

CLOSEOUT SUBMITTALS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Project Record Documents.
- B. Operation and Maintenance Data.
- C. Warranties and Bonds.

1.02 RELATED SECTIONS

- A. Section 01 30 00 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- B. Individual Product Sections: Specific requirements for operation and maintenance data.
- C. Individual Product Sections: Warranties required for specific products or Work.

1.03 SUBMITTALS

- A. Project Record Documents: Submit documents to Architect with claim for final Application for Payment.
- B. Operation and Maintenance Data:
 - 1. Submit two copies of preliminary draft or proposed formats and outlines of contents before start of Work. Architect will review draft and return one copy with comments.
 - 2. For equipment, or component parts of equipment put into service during construction and operated by Owner, submit completed documents within ten days after acceptance.
 - 3. Submit 1 copy of completed documents 15 days prior to final inspection. This copy will be reviewed and returned after final inspection, with Architect comments. Revise content of all document sets as required prior to final submission.
 - 4. Submit two sets of revised final documents in final form within 10 days after final inspection.
- C. Warranties and Bonds:
 - 1. For equipment or component parts of equipment put into service during construction with Owner's permission, submit documents within ten days after acceptance.
 - 2. Make other submittals within ten days after Date of Substantial Completion, prior to final Application for Payment.
 - 3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within ten days after acceptance, listing the date of acceptance as the beginning of the warranty period.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PROJECT RECORD DOCUMENTS

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
 - 1. Drawings.
 - 2. Addenda.
 - 3. Change Orders and other modifications to the Contract.
 - 4. Reviewed shop drawings, product data, and samples.

- B. Ensure entries are complete and accurate, enabling future reference by Owner.
- C. Store record documents separate from documents used for construction.
- D. Record information concurrent with construction progress.
- E. Record Drawings and Shop Drawings: Legibly mark each item to record actual construction including:
 - 1. Field changes of dimension and detail.
 - 2. Details not on original Contract drawings.

3.02 OPERATION AND MAINTENANCE DATA

- A. For Each Product or System: List names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.
- C. Drawings: Supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams. Do not use Project Record Documents as maintenance drawings.
- D. Typed Text: As required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions.

3.03 OPERATION AND MAINTENANCE MANUALS

- A. Prepare instructions and data by personnel experienced in maintenance and operation of described products.
- B. Prepare data in the form of an instructional manual.
- C. Binders: Commercial quality, 8-1/2 x 11 inch three D side ring binders with durable plastic covers; 2 inch maximum ring size. When multiple binders are used, correlate data into related consistent groupings.
- D. Cover: Identify binder with typed or printed title OPERATION AND MAINTENANCE INSTRUCTIONS; identify title of Project; identify subject matter of contents.
- E. Provide tabbed dividers for each separate product and system, with typed description of product and major component parts of equipment.
- F. Text: Manufacturer's printed data, or typewritten data on 24 pound paper.
- G. Drawings: Provide with reinforced punched binder tab. Bind in with text; fold larger drawings to size of text pages.
- H. Arrange content by systems under section numbers and sequence of Table of Contents of this Project Manual.
- I. Contents: Prepare a Table of Contents for each volume, with each product or system description identified, in three parts as follows:
 - 1. Part 1: Directory, listing names, addresses, and telephone numbers of Architect, Contractor, Subcontractors, and major equipment suppliers.
 - 2. Part 2: Operation and maintenance instructions, arranged by system and subdivided by specification section. For each category, identify names, addresses, and telephone numbers of Subcontractors and suppliers. Identify the following:
 - a. Significant design criteria.
 - b. List of equipment.
 - c. Parts list for each component.
 - d. Operating instructions.
 - e. Maintenance instructions for equipment and systems.

3. Part 3: Project documents and certificates, including the following:
 - a. Shop drawings and product data.
 - b. Certificates.
 - c. Photocopies of warranties and bonds.

3.04 WARRANTIES AND BONDS

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within ten days after completion of the applicable item of work. Except for items put into use with Owner's permission, leave date of beginning of time of warranty until the Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.
- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.
- E. Include originals of each in operation and maintenance manuals, indexed separately on Table of Contents.

END OF SECTION

SECTION 02 22 50

PARTIAL DEMOLITION FOR REMODELING

PART 1 GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Demolishing designated building equipment and fixtures.
 - 2. Demolishing designated construction.
 - 3. Cutting and alterations for completion of the Work.
 - 4. Removing designated items for reuse and Owner's retention.
 - 5. Protecting items designated to remain.
 - 6. Removing demolished materials.
- B. Related Sections:
 - 1. None.

1.2 SUBMITTALS

- A. Requirements for submittals.
- B. Describe demolition removal procedures and schedule.
- C. Shop Drawings:
 - 1. Indicate demolition and removal sequence.
 - 2. Indicate location of items designated for reuse and Owner's retention.
 - 3. Indicate location and construction of temporary work.

1.3 CLOSEOUT SUBMITTALS

- A. Requirements for submittals.
- B. Project Record Documents: Accurately record actual locations of capped utilities and subsurface obstructions.
- C. Operation and Maintenance Data: Submit description of system, inspection data, and parts lists.

1.4 QUALITY ASSURANCE

- A. Conform to applicable local code for demolition work, dust control, products requiring electrical disconnection and re-connection.
- B. Conform to applicable codes for procedures when hazardous or contaminated materials are discovered.

- C. Obtain required permits from authorities having jurisdiction.
- D. Perform Work in accordance with local building codes.

1.5 SCHEDULING

- A. Schedule Work to coincide with new construction.
 - B. Perform noisy, malodorous and dusty work:
 - 1. Between hours of 3:00pm and 5:30am on school days.
- OR
- 2. On following days: Saturdays or as approved by the district.
 - 3. Monday through Friday if School is closed for Summer, Spring Break or Winter Break.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 PREPARATION

- A. Notify affected utility companies before starting work and comply with their requirements.
- B. Mark location and termination of utilities.
- C. Erect, and maintain temporary barriers and security devices as required including warning signs and lights, and similar measures, for protection of the public, Owner, and existing improvements indicated to remain.
- D. Erect and maintain weatherproof closures for exterior openings.
- E. Erect and maintain temporary partitions to prevent spread of dust, odors, and noise to permit continued Owner occupancy.
- F. Prevent movement of structure; provide temporary bracing and shoring required to ensure safety of existing structure.
- G. Provide appropriate temporary signage including signage for exit or building egress.
- H. Do not close or obstruct building egress path.
- I. Do not disable or disrupt building fire or life safety systems without 3 days prior written notice to Owner.

3.2 SALVAGE REQUIREMENTS

- A. Coordinate with Owner to identify building components and equipment required to be removed and delivered to Owner.
- B. Tag components and equipment Owner designates for salvage.
- C. Protect designated salvage items from demolition operations until items can be removed.
- D. Carefully remove building components and equipment indicated to be salvaged.
- E. Disassemble as required to permit removal from building.
- F. Package small and loose parts to avoid loss.
- G. Mark equipment and packaged parts to permit identification and consolidation of components of each salvaged item.
- H. Prepare assembly instructions consistent with disassembled parts. Package assembly instructions in protective envelope and securely attach to each disassembled salvaged item.
- I. Deliver salvaged items to Owner. Obtain signed receipt from Owner.

3.3 DEMOLITION

- A. Conduct demolition to minimize interference with adjacent and occupied building areas.
- B. Cease operations immediately when structure appears to be in danger and notify Architect/Engineer.
- C. Disconnect, remove, cap, and identify designated utilities within demolition areas.
- D. Demolish in orderly and careful manner. Protect existing improvements, supporting structural members and protecting existing finishes.
- E. Carefully remove building components indicated to be reused.
 - 1. Disassemble components as required to permit removal.
 - 2. Package small and loose parts to avoid loss.
 - 3. Mark components and packaged parts to permit reinstallation.
 - 4. Store components, protected from construction operations, until reinstalled.
- F. Remove demolished materials from site except where specifically noted otherwise. Do not burn or bury materials on site.
- G. Remove materials as Work progresses. Upon completion of Work, leave areas in clean condition.
- H. Remove temporary Work.

3.4 SCHEDULES

- A. Remove, store and protect the following materials and equipment:
 - 1. Mechanical to be removed and reinstalled after curbs are raised.

END OF SECTION

SECTION 06 10 00
ROUGH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Structural floor, wall, and roof framing.
- B. Floor, wall, and roof sheathing.
- C. Preservative treatment of wood.
- D. Miscellaneous framing and sheathing.
- E. Telephone and electrical panel boards.
- F. Wood nailers and curbs for roofing and items installed on roof.

1.02 REFERENCES

- A. AFPA T10 - Wood Frame Construction Manual; American Forest and Paper Association; 2001.
- B. ASTM A 153/A 153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2005.
- C. AWPA C2 - Lumber, Timber, Bridge Ties and Mine Ties -- Preservative Treatment by Pressure Processes; American Wood-Preservers' Association; 2002.
- D. AWPA U1 - Use Category System: User Specification for Treated Wood; American Wood-Preservers' Association; 2005.
- E. PS 1 - Construction and Industrial Plywood; National Institute of Standards and Technology (Department of Commerce); 1995.
- F. PS 20 - American Softwood Lumber Standard; National Institute of Standards and Technology (Department of Commerce); 2005.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide technical data on wood preservative materials.

1.04 QUALITY ASSURANCE

- A. Lumber: Comply with PS 20 and approved grading rules and inspection agencies.
 - 1. Acceptable Lumber Inspection Agencies: Any agency with rules approved by American Lumber Standards Committee.
- B. Preservative-Treated Wood: Provide lumber and plywood marked or stamped by an ALSC-accredited testing agency, certifying level and type of treatment in accordance with AWPA standards.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Lumber fabricated from old growth timber is not permitted.

2.02 DIMENSION LUMBER

- A. Sizes: Nominal sizes as indicated on drawings, S4S.
- B. Moisture Content: S-dry or MC19.
- C. Stud Framing (2 x 2 through 2 x 6):
 - 1. Species: Douglas Fir-Larch.
 - 2. Grade: No. 2.
- D. Joist Framing (2 x 6 through 4 x 16):
 - 1. Species: Douglas Fir-Larch.
 - 2. Grade: No. 1 and better.
- E. Miscellaneous Blocking, Furring, and Nailers:
 - 1. Lumber: S4S, No. 2 or Standard Grade.

2.03 CONSTRUCTION PANELS

- A. Subflooring: APA Rated Sheathing.
 - 1. Exposure Class: Exterior.
 - 2. Span Rating: 32/16 inches.
- B. Roof Sheathing: APA Structural I Rated Sheathing, Exterior Exposure Class, and as follows:
 - 1. Span Rating: 24/0.
- C. Wall Sheathing: APA Structural I Rated Sheathing, Exterior Exposure Class, and as follows:
 - 1. Span Rating: 24/0.
- D. Other Applications:
 - 1. Concealed Plywood: PS 1, C-C Plugged, exterior grade.
 - 2. Exposed Plywood: PS 1, A-D, interior grade.
 - 3. Electrical Component Mounting: APA rated sheathing, fire retardant treated.

2.04 ACCESSORIES

- A. Fasteners and Anchors:
 - 1. Metal and Finish: Hot-dipped galvanized steel per ASTM A 153/A 153M for high humidity and preservative-treated wood locations, unfinished steel elsewhere.
- B. Subfloor Glue: Waterproof, water base, air cure type, cartridge dispensed.

2.05 FACTORY WOOD TREATMENT

- A. Treated Lumber and Plywood: Comply with requirements of AWPA U1 - Use Category System for wood treatments determined by use categories, expected service conditions, and specific applications.
- B. Preservative Pressure Treatment of Lumber Above Grade: AWPA Use Category UC3B, Commodity Specification A (Treatment C2) using waterborne preservative to 0.25 lb/cu ft retention.
 - 1. Kiln dry lumber after treatment to maximum moisture content of 19 percent.
 - 2. Treat lumber in contact with roofing or flashing.
 - 3. Treat lumber in contact with concrete.
 - 4. Treat lumber less than 18 inches above grade.

PART 3 EXECUTION

3.01 FRAMING INSTALLATION

- A. Set structural members level, plumb, and true to line. Discard pieces with defects that would lower required strength or result in unacceptable appearance of exposed members.

- B. Make provisions for temporary construction loads, and provide temporary bracing sufficient to maintain structure in true alignment and safe condition until completion of erection and installation of permanent bracing.
- C. Install structural members full length without splices unless otherwise specifically detailed.
- D. Comply with member sizes, spacing, and configurations indicated, and fastener size and spacing indicated, but not less than required by applicable codes and AFPA Wood Frame Construction Manual.
- E. Construct double joist headers at floor and ceiling openings and under wall stud partitions that are parallel to floor joists; use metal joist hangers unless otherwise detailed.
- F. Frame openings with two or more studs at each jamb; support headers on cripple studs.
- G. Provide miscellaneous members as indicated or as required to support finishes, fixtures, specialty items, and trim.

3.02 INSTALLATION OF CONSTRUCTION PANELS

- A. Subflooring: Glue and nail to framing; staples are not permitted.
- B. Roof Sheathing: Secure panels perpendicular to framing members, with ends staggered and sheet ends over firm bearing.
 - 1. Use sheathing clips between roof framing members.
 - 2. Provide solid edge blocking between sheets.
 - 3. Nail panels to framing; staples are not permitted.
- C. Wall Sheathing: Secure with long dimension perpendicular to wall studs, with ends over firm bearing and staggered, using nails, screws, or staples.

3.03 TOLERANCES

- A. Framing Members: 1/4 inch from true position, maximum.
- B. Variation from Plane (Other than Floors): 1/4 inch in 10 feet maximum, and 1/4 inch in 30 feet maximum.

END OF SECTION

SECTION 073113 - ASPHALT SHINGLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Asphalt shingles.
2. Underlayment.

B. Related Sections:

1. Division 07 Section "Sheet Metal Flashing and Trim" for metal roof penetration flashings counterflashing and flashings
2. Division 07 Section "Roof Accessories" for ridge vents.

1.3 DEFINITION

- A. Roofing Terminology: See ASTM D 1079 and glossary of NRCA's "The NRCA Roofing and Waterproofing Manual" for definitions of terms related to roofing work in this Section.

1.4 PRE-JOB AND PRIOR APPROVAL SUBMITTALS

- A. Product Data: For each type of product indicated.

- B. Samples for Initial Selection: For each type of asphalt shingle ridge and hip cap shingles indicated.

1. Include similar Samples of trim and accessories involving color selection.

- C. Samples for Verification: For the following products, of sizes indicated, to verify color selected:

1. Asphalt Shingle: Full size.
2. Ridge and Hip Cap Shingles: Full size.
3. Ridge Vent: 12-inch long Sample.
4. Exposed Valley Lining: 12 inches square.
5. Self-Adhering Underlayment: 12 inches square.

- D. Qualification Data: For qualified Installer.

- E. Product Test Reports: Based on evaluation of comprehensive tests performed by manufacturer and witnessed by a qualified testing agency, for asphalt shingles.
- F. Research/Evaluation Reports: For each type of asphalt shingle required, from the ICC
- G. Maintenance Data: For each type of asphalt shingle to include in maintenance manuals.
- H. Warranties: Sample of special warranties.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.
- B. Source Limitations: Obtain ridge and hip cap shingles ridge vents felt underlayment and self-adhering sheet underlayment from single source from single manufacturer.
- C. Fire-Resistance Characteristics: Where indicated, provide asphalt shingles and related roofing materials identical to those of assemblies tested for fire resistance per test method below by UL or another testing and inspecting agency acceptable to authorities having jurisdiction. Identify products with appropriate markings of applicable testing agency.
 - 1. Exterior Fire-Test Exposure: [**Class A**]; ASTM E 108 or UL 790, for application and roof slopes indicated.
- D. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.
 - 1. Build mockups for asphalt shingles including related roofing materials.
 - a. Size: **48 inches (1200 mm) long by 48 inches (1200 mm) wide**
 - 2. Approval of mockups does not constitute approval of deviations from the Contract Documents contained in mockups unless Architect specifically approves such deviations in writing.
 - 3. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.
- E. Preinstallation Conference: Conduct conference at Roadrunner Elementary school

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Store roofing materials in a dry, well-ventilated, weathertight location according to asphalt shingle manufacturer's written instructions. Store underlayment rolls on end on pallets or other raised surfaces. Do not double stack rolls.
 - 1. Handle, store, and place roofing materials in a manner to avoid significant or permanent damage to roof deck or structural supporting members.

- B. Protect unused underlayment from weather, sunlight, and moisture when left overnight or when roofing work is not in progress.

1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install asphalt shingles until spaces are enclosed and weathertight, wet work in spaces is complete and dry, and temporary HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.
 - 1. Install self-adhering sheet underlayment within the range of ambient and substrate temperatures recommended by manufacturer.

1.8 WARRANTY

- A. Special Warranty: Standard form in which manufacturer agrees to repair or replace asphalt shingles that fail in materials or workmanship within specified warranty period.
 - 1. Failures include, but are not limited to, the following:
 - a. Manufacturing defects.
 - b. Structural failures including failure of asphalt shingles to self-seal after a reasonable time.
 - 2. Material Warranty Period: **20** years from date of Substantial Completion.
 - 3. Wind-Speed Warranty Period: Asphalt shingles will resist blow-off or damage caused by wind speeds up to **80 mph**, **10** years from date of Substantial Completion.
 - 4. Algae-Discoloration Warranty Period: Asphalt shingles will not discolor **10** years from date of Substantial Completion.
 - 5. Workmanship Warranty Period: **2** years from date of Substantial Completion.
- B. Special Project Warranty: Roofing Installer's Warranty, or warranty form at end of this Section, signed by roofing Installer, covering the Work of this Section, in which roofing Installer agrees to repair or replace components of asphalt shingle roofing that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period: **Five** years from date of Substantial Completion.

1.9 EXTRA MATERIALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Asphalt Shingles: **100 sq. ft** of each type, in unbroken bundles.

PART 2 - PRODUCTS

2.1 GLASS-FIBER-REINFORCED ASPHALT SHINGLES

- A. Laminated-Strip Asphalt Shingles: ASTM D 3462, laminated, multi-ply overlay construction, glass-fiber reinforced, mineral-granule surfaced, and self-sealing.
1. Manufacturers: See below
 2. Basis-of-Design Product: Subject to compliance with requirements, provide or comparable product by one of the following:
 - a. Elk Premium Building Products, Inc.; Products; 30 year laminated shingle
 - b. GAF Materials Corporation ; Products; 30 year laminated shingle
 - c. TAMKO Roofing Products, Inc. ; Products; 30 year laminated shingle
 - d. PABCO Roofing Products; 30 year laminated shingle
 - e. Architect's approved equal
 3. Butt Edge: cut.
 4. Strip Size: Manufacturer's standard
 5. Algae Resistance: Granules treated to resist algae discoloration.
 6. Color and Blends: As selected by the Owner
- B. Hip and Ridge Shingles: Manufacturer's standard units to match asphalt shingles.

2.2 UNDERLAYMENT MATERIALS

- A. Felt: **ASTM D 226, Type II**, 30lb, asphalt-saturated organic felts, nonperforated.
- B. Self-Adhering Sheet Underlayment, Granular Surfaced: ASTM D 1970, minimum of **55-mil-(1.4-mm-)** thick sheet; glass-fiber-mat-reinforced, SBS-modified asphalt; mineral-granule surfaced; with release paper backing; cold applied.
1. Manufacturers: Subject to compliance with requirements:
 2. Basis-of-Design Product: Subject to compliance with requirements, provide or comparable product by one of the following:
 - a. Carlisle Coatings & Waterproofing, Inc.
 - b. Grace, W.R.
 - c. GAF Materials Corporation.
 - d. Henry Company
 - e. SateSeal Innovations
 - f. Or architects approved equal

2.3 RIDGE VENTS

- A. Rigid Ridge Vent: Manufacturer's standard, rigid section high-density polypropylene or other UV-stabilized plastic ridge vent for use under ridge shingles.

1. Manufacturers: Subject to compliance with requirements, Basis-of-Design Product: Subject to compliance with requirements, provide or comparable product by one of the following:
 - a. Air Vent, Inc.; a Gibraltar Industries company.
 - b. Cor-A-Vent, Inc.
 - c. GAF Materials Corporation.
 - d. Owens Corning.
 - e. Trimline Building Products.
 - f. Or architects approved equal

2.4 ACCESSORIES

- A. Asphalt Roofing Cement: ASTM D 4586, Type II, asbestos free.
- B. Roofing Nails: ASTM F 1667; aluminum, stainless-steel, copper, or hot-dip galvanized-steel wire shingle nails, minimum **0.120-inch- (3-mm-)** diameter, barbed shank, sharp-pointed, with a minimum **3/8-inch- (9.5-mm-)** diameter flat head and of sufficient length to penetrate **3/4 inch (19 mm)** into solid wood decking or extend at least **1/8 inch (3 mm)** through OSB or plywood sheathing.
 1. Where nails are in contact with metal flashing, use nails made from same metal as flashing.
- C. Felt Underlayment Nails: Aluminum, stainless-steel, or hot-dip galvanized-steel wire with low-profile capped heads or disc caps, **1-inch (25-mm)** minimum diameter.

2.5 METAL FLASHING AND TRIM

- A. General: Comply with requirements in Division 07 Section "Sheet Metal Flashing and Trim."
 1. Sheet Metal: match existing profiles and thickness. Paint to match campus standard.
- B. Fabricate sheet metal flashing and trim to comply with recommendations in SMACNA's "Architectural Sheet Metal Manual" that apply to design, dimensions, metal, and other characteristics of the item.
 1. Apron Flashings: match existing
 2. Step Flashings: match existing
 3. Open-Valley Flashings: Fabricate in lengths not exceeding **10 feet** with **1-inch- (25-mm-)** high, inverted-V profile at center of valley and equal flange widths of **10 inches**.
 4. Drip Edges: Fabricate in lengths not exceeding **10 feet** with **2-inch** roof-deck flange and **1-1/2-inch** fascia flange with **3/8-inch** drip at lower edge.
- C. Vent Pipe Flashings: ASTM B 749, Type L51121, at least **1/16 inch** thick. Provide lead sleeve sized to slip over and turn down into pipe, soldered to skirt at slope of roof, and extending at least **4 inches** from pipe onto roof.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
 - 1. Examine roof sheathing to verify that sheathing joints are supported by framing and blocking or metal clips and that installation is within flatness tolerances.
 - 2. Verify that substrate is sound, dry, smooth, clean, sloped for drainage, and completely anchored; and that provision has been made for flashings and penetrations through asphalt shingles.
- B. Prepare written report, endorsed by Installer, listing conditions detrimental to performance of the Work.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 UNDERLAYMENT INSTALLATION

- A. General: Comply with underlayment manufacturer's written installation instructions applicable to products and applications indicated unless more stringent requirements apply.
- B. Double-Layer Felt Underlayment: Install on roof deck parallel with and starting at the eaves. Install a **19-inch-** wide starter course at eaves and completely cover with full-width second course. Install succeeding courses lapping previous courses **19 inches** in shingle fashion. Lap ends a minimum of **6 inches**. Stagger end laps between succeeding courses at least **72 inches**. Fasten with felt underlayment roofing nails.
 - 1. Apply a continuous layer of asphalt roofing cement over starter course and on felt underlayment surface to be concealed by succeeding courses as each felt course is installed. Apply over entire roof.
 - 2. Install felt underlayment on roof sheathing not covered by self-adhering sheet underlayment. Lap edges over self-adhering sheet underlayment not less than **3 inches** in direction to shed water.
 - 3. Terminate felt underlayment extended up not less than **4 inches** against sidewalls, curbs, chimneys, and other roof projections.
 - 4. Install fasteners at no more than **36 inch** o.c.
- C. Self-Adhering Sheet Underlayment: Install, wrinkle free, on roof deck. Comply with low-temperature installation restrictions of underlayment manufacturer if applicable. Install at locations indicated **on Drawings**, lapped in direction to shed water. Lap sides not less than **3-1/2 inches (89 mm)**. Lap ends not less than **6 inches (150 mm)** staggered **24 inches (600 mm)** between courses. Roll laps with roller. Cover underlayment within seven days.
 - 1. Prime concrete and masonry surfaces to receive self-adhering sheet underlayment.
 - 2. Eaves: Extend from edges of eaves **36 inches** beyond interior face of exterior wall.
 - 3. Rakes: Extend from edges of rake **36 inches** beyond interior face of exterior wall.
 - 4. Valleys: Extend from lowest to highest point **24 inches** on each side.

5. Hips: Extend 24 **inches** on each side.
 6. Ridges: Extend **36 inches** on each side without obstructing continuous ridge vent slot.
 7. Sidewalls: Extend beyond sidewall **18 inches** and return vertically against sidewall not less than **4 inches**.
 8. Other Roof-Penetrating Elements: Extend beyond penetrating element **18 inches** and return vertically against penetrating element not less than **4 inches**.
 9. Roof Slope Transitions: Extend **18 inches** on each roof slope.
- D. Metal-Flashed, Open-Valley Underlayment: Install two layers of **36-inch-** wide felt underlayment centered in valley. Stagger end laps between layers at least **72 inches**. Lap ends of each layer at least **12 inches** in direction to shed water, and seal with asphalt roofing cement. Fasten each layer to roof deck with felt underlayment nails.
1. Lap roof-deck felt underlayment over first layer of valley felt underlayment at least **6 inches**.

3.3 METAL FLASHING INSTALLATION

- A. General: Install metal flashings and other sheet metal to comply with requirements in Division 07 Section "Sheet Metal Flashing and Trim."
1. Install metal flashings according to recommendations in ARMA's "Residential Asphalt Roofing Manual" and asphalt shingle recommendations in NRCA's "The NRCA Roofing and Waterproofing Manual."
- B. Apron Flashings: Extend lower flange over and beyond each side of downslope asphalt shingles and up the vertical surface.
- C. Step Flashings: Install with a headlap of **2 inches** and extend over the underlying asphalt shingle and up the vertical surface. Fasten to roof deck only.
- D. Backer Flashings: Install against the roof-penetrating element extending concealed flange beneath upslope asphalt shingles and beyond each side.
- E. Open-Valley Flashings: Install centered in valleys, lapping ends at least **8 inches** in direction to shed water. Fasten upper end of each length to roof deck beneath overlap.
1. Secure hemmed flange edges into metal cleats spaced **12 inches** apart and fastened to roof deck.
 2. Adhere **9-inch-** wide strip of self-adhering sheet to metal flanges and to self-adhering sheet underlayment.
- F. Rake Drip Edges: Install rake drip edge flashings over underlayment and fasten to roof deck.
- G. Eave Drip Edges: Install eave drip edge flashings below underlayment and fasten to roof sheathing.
- H. Pipe Flashings: Form flashing around pipe penetrations and asphalt shingles. Fasten and seal to asphalt shingles as recommended by manufacturer.

3.4 ASPHALT SHINGLE INSTALLATION

- A. General: Install asphalt shingles according to manufacturer's written instructions, recommendations in ARMA's "Residential Asphalt Roofing Manual," and asphalt shingle recommendations in NRCA's "The NRCA Roofing and Waterproofing Manual."
- B. Install starter strip along lowest roof edge, consisting of an asphalt shingle strip **at least 7 inches wide** with self-sealing strip face up at roof edge.
 - 1. Extend asphalt shingles **1/2 inch** over fascia at eaves and rakes.
 - 2. Install starter strip along rake edge.
- C. Install first and remaining courses of asphalt shingles stair-stepping diagonally across roof deck with manufacturer's recommended offset pattern at succeeding courses, maintaining uniform exposure.
- D. Install first and remaining courses of asphalt shingles stair-stepping diagonally across roof deck with manufacturer's recommended offset pattern at succeeding courses, maintaining uniform exposure.
- E. Install asphalt shingles by single-strip column or racking method, maintaining uniform exposure. Install full-length first course followed by cut second course, repeating alternating pattern in succeeding courses.
- F. Fasten asphalt shingle strips with a minimum of four roofing nails located according to manufacturer's written instructions.
 - 1. Where roof slope is less than 4:12, seal asphalt shingles with asphalt roofing cement spots.
 - 2. When ambient temperature during installation is below **50 deg F** seal asphalt shingles with asphalt roofing cement spots.
- G. Closed-Cut Valleys: Extend asphalt shingle strips from one side of valley **12 inches** beyond center of valley. Use one-piece shingle strips without joints in valley. Fasten with extra nail in upper end of shingle. Install asphalt shingle courses from other side of valley and cut back to a straight line **2 inches** short of valley centerline. Trim upper concealed corners of cut-back shingle strips.
 - 1. Do not nail asphalt shingles within **6 inches** of valley center.
 - 2. Set trimmed, concealed-corner asphalt shingles in a **3-inch-** wide bed of asphalt roofing cement.
- H. Ridge Vents: Install continuous ridge vents over asphalt shingles according to manufacturer's written instructions. Fasten with roofing nails of sufficient length to penetrate sheathing.
- I. Ridge and Hip Cap Shingles: Maintain same exposure of cap shingles as roofing shingle exposure. Lap cap shingles at ridges to shed water away from direction of prevailing winds. Fasten with roofing nails of sufficient length to penetrate sheathing.
 - 1. Fasten ridge cap asphalt shingles to cover ridge vent without obstructing airflow.

3.5 ROOFING INSTALLER'S WARRANTY

- A. WHEREAS **<Insert name>** of **<Insert address>**, herein called the "Roofing Installer," has performed roofing and associated work ("work") on the following project:
1. Owner: **<Insert name of Owner>**.
 2. Address: **<Insert address>**.
 3. Building Name/Type: **<Insert information>**.
 4. Address: **<Insert address>**.
 5. Area of Work: **<Insert information>**.
 6. Acceptance Date: **<Insert date>**.
 7. Warranty Period: **<Insert time>**.
 8. Expiration Date: **<Insert date>**.
- B. AND WHEREAS Roofing Installer has contracted (either directly with Owner or indirectly as a subcontractor) to warrant said work against leaks and faulty or defective materials and workmanship for designated Warranty Period,
- C. NOW THEREFORE Roofing Installer hereby warrants, subject to terms and conditions herein set forth, that during Warranty Period he will, at his own cost and expense, make or cause to be made such repairs to or replacements of said work as are necessary to correct faulty and defective work and as are necessary to maintain said work in a watertight condition.
- D. This Warranty is made subject to the following terms and conditions:
1. Specifically excluded from this Warranty are damages to work and other parts of the building, and to building contents, caused by:
 - a. Lightning;
 - b. Peak gust wind speed exceeding 85 mph (m/sec);
 - c. Fire;
 - d. Failure of roofing system substrate, including cracking, settlement, excessive deflection, deterioration, and decomposition;
 - e. Vapor condensation on bottom of roofing; and
 - f. Activity on roofing by others, including construction contractors, maintenance personnel, other persons, and animals, whether authorized or unauthorized by Owner.
 2. When work has been damaged by any of foregoing causes, Warranty shall be null and void until such damage has been repaired by Roofing Installer and until cost and expense thereof have been paid by Owner or by another responsible party so designated.
 3. Roofing Installer is responsible for damage to work covered by this Warranty but is not liable for consequential damages to building or building contents resulting from leaks or faults or defects of work.
 4. During Warranty Period, if Owner allows alteration of work by anyone other than Roofing Installer, including cutting, patching, and maintenance in connection with penetrations, attachment of other work, and positioning of anything on roof, this Warranty shall become null and void on date of said alterations, but only to the extent said alterations affect work covered by this Warranty. If Owner engages Roofing Installer to perform said alterations, Warranty shall not become null and void unless Roofing Installer, before starting said work, shall have notified Owner in writing,

showing reasonable cause for claim, that said alterations would likely damage or deteriorate work, thereby reasonably justifying a limitation or termination of this Warranty.

5. During Warranty Period, if original use of roof is changed and it becomes used for, but was not originally specified for, a promenade, work deck, spray-cooled surface, flooded basin, or other use or service more severe than originally specified, this Warranty shall become null and void on date of said change, but only to the extent said change affects work covered by this Warranty.
6. Owner shall promptly notify Roofing Installer of observed, known, or suspected leaks, defects, or deterioration and shall afford reasonable opportunity for Roofing Installer to inspect work and to examine evidence of such leaks, defects, or deterioration.
7. This Warranty is recognized to be the only warranty of Roofing Installer on said work and shall not operate to restrict or cut off Owner from other remedies and resources lawfully available to Owner in cases of roofing failure. Specifically, this Warranty shall not operate to relieve Roofing Installer of responsibility for performance of original work according to requirements of the Contract Documents, regardless of whether Contract was a contract directly with Owner or a subcontract with Owner's General Contractor.

E. IN WITNESS THEREOF, this instrument has been duly executed this **<Insert day>** day of **<Insert month>**, **<Insert year>**.

1. Authorized Signature: **<Insert signature>**.
2. Name: **<Insert name>**.
3. Title: **<Insert title>**.

END OF SECTION 073113

SECTION 07550
MODIFIED BITUMEN ROOFING

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. 2-Ply Low Sloped Roofing
- B. Edge Treatment and Roof Penetration Flashings.

1.2 SUMMARY OF WORK – All Modified Bituminous Membranes Must Be Manufactured/Supplied and Warrantied by One Manufacturer.

- A. Scope of Work: Buildings 1002
 1. Remove existing roofing assembly down to light weight concrete or structural deck.
 2. Install polyisocyanurate insulation (1.5-inch min.) per wind uplift calculations. See roof plans for depth of insulation or match existing depth.
 3. Fully adhere ½" asphalt coated wood fiberboard insulation (recovery board) in Type IV asphalt.
 4. Install factory tapered crickets as required to create positive slope to drains.
 5. Install perlite cant strips at all 90 degree angles.
 6. In field, fully adhere one ply of SBS modified smooth surfaced membrane with specified tensile and tear strengths in Type IV asphalt.
 7. In field, fully adhere one ply of modified surfacing membrane with specified tensile and tear strengths in Type IV asphalt.
 8. At all base flashings, fully adhere one ply of modified smooth surfaced membrane with specified tensile and tear strengths in Type IV asphalt.
 9. Over smooth surfaced base flashing ply, fully adhere one ply of thermoplastic membrane in low rise adhesive/Type IV asphalt/bonding adhesive.
 10. Strip in base flashing membrane to field surfacing membrane with asphalt mastic, reinforced with fiberglass mesh; broadcast granules into top layer of asphalt mastic.
 11. Install new metal flashings, including but not limited to drip edge, copings, counter flashings, slip flashings, scuppers, lead jacks, lead at drains, and pitch pans/covers.
 12. Properly support all conduit, gas lines and any other roof top lines to complete the roof with UV resistant and galvanized supports blocking.
 13. Spray apply acrylic white coating to surfaced membrane, base flashings, pipe penetrations, and miscellaneous areas; application must be applied in two coats in cross-hatch manner. **Building 1009 and is a roof coating only as described above. Clean roof and repair any roof damage prior to coating.**

1.3 REFERENCES

- A. Roofing Terminology:
 1. RCI "Glossary of Building Envelope Terms."
 2. Glossary of Terms: SMACNA "Architectural Sheet Metal Manual."
 3. ASTM D 1079 "Standard Terminology Relating to Roofing & Waterproofing."
 4. Glossary of Terms: "National Roofing Contractors Association Roofing and Waterproofing Manual."

1.4 DESIGN / PERFORMANCE REQUIREMENTS

- A. Perform work in accordance with all federal, state and local codes.
- B. Exterior Fire Test Exposure: Roof system submitted shall achieve a UL, Intertek-WH or FM Class rating. Rating must meet state and local codes.
- C. Design Requirements – **Architect to provide applicable pressures and Manufacture to provide fastening pattern.**

1.5 SUBMITTALS

- A. Submit under provisions of Section 01300.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Preparation instructions and recommendations.
 - 2. Storage and handling requirements and recommendations.
 - 3. Installation instructions.
- C. Shop Drawings: Contractor must submit shop drawings including installation details of roofing, flashing, fastening, insulation, including notation of roof slopes and fastening patterns of insulation and base modified bitumen membrane, prior to job start.
- D. Design Pressure Calculations: Manufacturer must submit fastening patterns from provided design pressure calculations for the site-specific roof areas in accordance with ASCE 7 and local Building Code requirements.
- E. Verification Samples: For each product specified, two samples, minimum size 6 inches (150 mm) square, representing actual product, color, and patterns.
- F. Test Reports: Submit test reports, prepared by an independent testing agency, for all modified bituminous surfacing sheets, indicating compliance with ASTM D5147.
- G. Manufacturer's Fire Compliance Certificate: Certify that the roof system furnished is tested by a third party in accordance with ASTM E108 or UL 790 and meets local or nationally recognized building codes.
- H. Closeout Submittals: Provide manufacturer's maintenance instructions that include recommendations for periodic inspection and maintenance of all completed roofing work.

1.6 QUALITY ASSURANCE

- A. Perform Work in accordance with NRCA Roofing and Waterproofing Manual.
- B. Installer Qualifications: Company specializing in performing work of this section with a minimum of five (5) years documented experience and is certified and pre-approved by the manufacturer unless stated differently in the RFP.
- C. Installer's Field Supervision: Maintain a full-time foreman on job site during all phases of roofing work while roofing work is in progress.

1.7 PRODUCT INFORMATION REQUIRED WITH BID SUBMITTAL AND DUE AT BID OPENING

- A. Required Product Information to be submitted with bid:
 - 1. Product identification: including Manufacturer's current literature and Manufacturer's name and address.
 - 2. Letter from manufacturer stating they will provide field inspections no less than a minimum of one (1) day each week, on during, and until all construction work is completed and accepted by the Owner and Architect.
- B. Products will not be considered if:
 - 1. Product or method of major waterproofing field components to be considered does not have a minimum of five (5) years of successful performance in roofing and reroofing applications in Arizona.
 - 2. The independent test data does not meet or exceed the minimum performance standards specified.
 - 3. Acceptance will require substantial revision of Contract Documents.
 - 4. Architect/ Owner reserves the right to be the final authority on the acceptance or rejection of any and all products.

1.8 PRE-INSTALLATION MEETINGS

- A. Convene minimum two weeks prior to commencing Work of this section.
- B. Review installation procedures and coordination required with related Work.
- C. Inspect and make notes of job conditions prior to installation:
 - 1. Record minutes of the conference and provide copies to all parties present.
 - 2. Identify all outstanding issues in writing designating the responsible party for follow-up action and the timetable for completion.
 - 3. Installation of roofing system shall not begin until all outstanding issues are resolved to the satisfaction of the Architect.

1.9 DELIVERY, STORAGE, AND HANDLING

- A. Deliver and store products in manufacturer's unopened packaging with labels intact until ready for installation.
- B. Store all roofing materials in a dry place, on pallets or raised platforms, out of direct exposure to the elements until time of application. Store materials at least 4 inches above ground level and covered with "breathable" tarpaulins.
- C. Stored in accordance with the instructions of the manufacturer prior to their application or installation. Store roll goods on end on a clean flat surface. No wet or damaged materials will be used in the application.
- D. Refer to manufacturer's published requirements for additional storing recommendations.

1.10 COORDINATION

- A. Coordinate Work with installing associated metal flashings as work of this section proceeds.

1.11 PROJECT CONDITIONS

- A. Maintain environmental conditions (temperature, humidity, and ventilation) within limits

recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.

1.12 WARRANTY

- A. Upon completion of the work, provide the Manufacturer's written and signed NDL (no dollar limit) Warranty. Warranty shall cover defective material or defective workmanship by the installing contractor. The manufacturer shall provide the Owner, at the Manufacturer's expense, with the labor and material necessary to return the defective area to a watertight condition.
 - 1. Warranty Period:
 - a) 20 years NDL from date of acceptance. (NDL) material and labor warranty to be provided by the manufacturer for all the types of roofing failures which will include roof leaks, blisters, ponding, sliding materials, and loss of granules.
- B. Installer is to guarantee all work against defects in materials and workmanship for the period indicated following final acceptance of the Work.
 - 1. Warranty Period:
 - a) 2 years from date of acceptance.

PART 2 PRODUCTS

2.1 MANUFACTURERS –The Products specified are intended and the Standard of Quality for the products required for this project.

2.2 2-PLY LOW SLOPED ROOFING

- A. Inter-Ply Adhesive: ASTM D 312, Type IV special steep asphalt approved by membrane manufacturer.
- B. Waterproofing Assembly: Multi Ply SBS Modified Bitumen Roofing System with a minimum of two and a maximum of three plies, where the combination of the plies meets or exceeds 500 lbf. / in. of tensile strength and 850 lbf. / in. of tear strength when tested per ASTM D 5147 @ 73.4 +/- 3.6 deg F.
 - 1. All plies may contain any combination of the following scrim reinforcements:
 - a) Polyester Scrim Reinforcement - ASTM D 6164.
 - b) Fiberglass Scrim Reinforcement - ASTM D 6163.
 - c) Dual Fiberglass Scrim Reinforcements - ASTM D 6162.
- C. Flashing Cap Ply Sheet: 60-mil high-performance reinforced thermoplastic membrane approved by membrane manufacturer.
- D. Surfacing: White elastomeric Energy Star coating approved by membrane manufacturer.

2.3 ACCESSORIES:

- A. Fasteners: Non-ferrous metal or galvanized steel, except that hard copper nails shall be used with copper; aluminum or stainless steel nails shall be used with aluminum; and stainless steel nails shall be used with stainless steel, Fasteners shall be self-clinching type of penetrating type as recommended by the deck manufacturer. Fasten nails and fasteners flush-driven through flat metal discs not less than 1 inch (25 mm) diameter. Omit metal discs

when one-piece composite nails or fasteners with heads not less than 1 inch (25 mm) diameter are used.

- B. Asphalt Primer: Approved by Membrane Manufacturer for 20-year NDL warranty.
- C. Flashing Cap Adhesive: Approved by Membrane Manufacturer for 20-year NDL warranty. .
- D. Base Sheet for tie ins: Approved by Membrane Manufacturer for 20-year NDL warranty. .
- E. Asphalt Mastic: Approved by Membrane Manufacturer for 20-year NDL warranty.
- F. Three Course Reinforcing Mesh: Approved by Membrane Manufacturer for 20-year NDL warranty.
- G. Wood Nailers
- H. Pipe, Conduit, Power-runs & Condensate Line Supports: Approved by Membrane Manufacturer for 20-year NDL warranty.
- I. Urethane Sealant: One part, non-sag sealant Approved by Membrane Manufacturer for 20-year NDL warranty.
- J. Structural Adhesive: Single component, 100% solids structural adhesive Approved by Membrane Manufacturer for 20-year NDL warranty.
- K. Butyl Tape: 100% solids, asbestos free and compressive tape designed to seal as recommended and furnished by the membrane manufacturer for 20-year NDL warranty.
- L. Liquid Flashing Reinforced w/ Polyester: Polyurethane-based, low-odor, liquid flashing membrane Approved by Membrane Manufacturer for 20-year NDL warranty.
- M. Liquid Flashing Reinforcement: Strong, elastic, polyester reinforcing fabric Approved by Membrane Manufacturer for 20-year NDL warranty for 20-year NDL warranty.
- N. Roof Insulation:
 - 1. Rigid Polyisocyanurate Roof Insulation; ASTM C1289 Approved by Membrane Manufacturer for 20-year NDL warranty.
 - a. Thickness: Identified in drawings.
 - 2. Tapered Polyisocyanurate Roof Insulation; ASTM C1289.
 - 3. High Density Fiberboard Roof insulation; ASTM C208.
 - 4. Cant and Tapered Edge Strips; ASTM C728.
 - 5. Tapered Perlite Roof Insulation; ASTM C728.

2.4 EDGE TREATMENT AND ROOF PENETRATION FLASHINGS

- A. Drain Flashings should be 4lb (1.8kg) sheet lead formed and rolled.
- B. Plumbing Stacks should be 4lb (1.8kg) sheet lead formed and rolled.
- C. Cylinder Support Pipes Flashings should be 4lb (1.8kg) sheet lead formed and rolled.
- D. Fabricated Flashings: Fabricated flashings and trim:

1. Fabricated flashings and trim shall conform to the detail requirements of SMACNA "Architectural Sheet Metal Manual" and/or the CDA Copper Development Association "Copper in Architecture - Handbook" as applicable. Match existing.
2. Approved by Membrane Manufacturer.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Do not begin installation until substrates have been properly prepared.
- B. Inspect and approve the deck condition, slopes and fastener backing if applicable, parapet walls, expansion joints, roof drains, stack vents, vent outlets, nailers and surfaces and elements.
- C. Verify that work penetrating the roof deck, or which may otherwise affect the roofing, has been properly completed.
- D. If substrate preparation and other conditions are the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.2 PREPARATION

- A. General: Clean surfaces thoroughly prior to installation.
 1. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
 2. Fill substrate surface voids that are greater than 1/4" wide with an acceptable fill material.
 3. Roof surface to receive roofing system shall be smooth, clean, free from loose gravel, dirt and debris, dry and structurally sound.
 4. Wherever necessary, all surfaces to receive roofing materials shall be power broom and vacuumed to remove debris and loose matter prior to starting work.
 5. Do not apply roofing during inclement weather. Do not apply roofing components to damp or wet surfaces.

3.3 INSULATION INSTALLATION (General)

- A. Metal Deck Mechanical Attachment:
 1. Mechanically attach approved insulation board per manufacturer's wind uplift calculations with plates and fasteners.
 2. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
 3. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no

circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.

4. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
5. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
6. Install no more insulation at one time than can be roofed on the same day.
7. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
8. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.
9. Minimum penetration into deck shall be as recommended by the fastener manufacturer. There is a one (1) inch minimum for metal.

B. Wood Deck Mechanical Attachment:

1. Mechanically attach approved insulation board per manufacturer's wind uplift calculations with plates and fasteners.
2. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.
4. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
5. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
6. Install no more insulation at one time than can be roofed on the same day.
7. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
8. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.
9. Minimum penetration into deck shall be as recommended by the fastener manufacturer. There is a one (1) inch minimum for wood.

C. Light Weight Concrete Deck, Tectum Deck, and Gypsum Deck Mechanical Attachment:

1. Mechanically attach base sheet to deck per manufacturer's wind uplift calculations with plates and fasteners.
2. Over base sheet, embed one layer of rigid insulation board in solid moppings of hot asphalt at the rate and temperature recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
4. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.
5. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
6. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
7. Install no more insulation at one time than can be roofed on the same day.
8. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
9. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.

D. Concrete Deck Attachment:

1. Over the entire deck surface, prime concrete surfaces with asphalt primer at the rate of 1 (one) gallon per one hundred (100) square feet.
2. Embed one layer of rigid insulation board in solid moppings of hot asphalt at the rate and temperature recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
3. Embed second layer of insulation board in solid moppings of hot asphalt after first layer has been attached as recommended by insulation manufacturer. Stagger end joints of boards so all open joints will be eliminated. Walk in each piece of insulation and leave boards completely adhered to base felt or deck. Each insulation board shall be butt firmly against adjoining panels. All open joints shall be eliminated.
4. Approved insulation shall be tapered around roof drains and scuppers. Tapered insulation sump shall start with a thickness of one-half at drain bowl to the specified dimension of three feet from the center line of the drain. Install tapered insulation sump in such a way to provide proper slope for runoff. Shape insulation with tool as

required so completed surface is smooth and flush with ring of drain. Under no circumstances will the membrane be left unsupported in an area greater than one quarter (1/4) inch. Install recovery board over tapered insulation sump as required.

5. Approved recovery board one half (1/2) inch thickness shall be installed over base tapered insulation using hot asphalt at the rate of approximately thirty-three (33) pounds per square.
6. All boards shall be cut and fitted where the roof deck intersects a vertical surface. The boards shall be cut to fit a minimum of one quarter (1/4) inch away from the vertical surface.
7. Install no more insulation at one time than can be roofed on the same day.
8. Install temporary water cut-offs at completion of each day's work and remove upon resumption of work.
9. Cant Strips/Tapered Edge Strips: Install preformed forty five (45) degree cant strip at junctures of vertical surfaces. Provide preformed, tapered edge strips at perimeter of edges of roof that do not terminate at vertical surfaces and/or indicated on the drawings.
10. Tape joints of insulation as per manufacturer's requirements.

3.4 INSTALLATION - GENERAL

- A. Install modified bitumen membranes and flashings in accordance with manufacturer's instructions and with the recommendations provided by the National Roofing Contractors Association's Roofing & Waterproofing Manual, the Asphalt Roofing Manufacturers Association, and applicable codes.
- B. General: Avoid installation of modified bitumen membranes at temperatures lower than 40-45 degrees F. When work at such temperatures unavoidable use the following precautions:
 1. Take extra care during cold weather installation and when ambient temperatures are affected by wind or humidity, to ensure adequate bonding is achieved between the surfaces to be joined. Use extra care at material seam welds and where adhesion of the applied product to the appropriately prepared substrate as the substrate can be affected by such temperature constraints as well.
 2. Unrolling of cold materials, under low ambient conditions must be avoided to prevent the likelihood of unnecessary stress cracking. Rolls must be at least 40 degrees F at the time of application. If the membrane roll becomes stiff or difficult to install, it must be replaced with roll from a heated storage area.
- C. Commence installation of the roofing system at the lowest point of the roof (or roof area), working up the slope toward the highest point. Lap sheets shingle fashion so as to constantly shed water
- D. All slopes greater than 2:12 require back-nailing to prevent slippage of the ply sheets. Use ring or spiral-shank 1 inch cap nails, or screws and plates at a rate of 1 fastener per ply (including the membrane) at each insulation stop. Place insulation stops at 16 ft. o.c. for slopes less than 3:12 and 4 feet o.c. for slopes greater than 3:12. On non-insulated systems, nail each ply directly into the deck at the rate specified above. When slope exceeds 2:12, install all plies parallel to the slope (strapping) to facilitate back-nailing. Install 4 additional fasteners at the upper edge of the membrane when strapping the plies.

3.5 INSTALLATION HOT APPLIED ROOF SYSTEM

- A. Base Ply: Install base ply in twenty-five (25) lbs. (11.3kg) per square of bitumen shingled uniformly to achieve one or more plies over the entire prepared substrate. Shingle in direction of slope of roof to shed water on each area of roof. Do not step on base rolls until asphalt has cooled, fish mouths should be cut and patched.
1. Lap ply sheet ends 8 inches (203 mm). Stagger end laps 2 inches (304mm) minimum.
 2. Install base flashing ply to all perimeter and projection details after membrane application.
 3. Extend plies 2 inches beyond top edges of cants at wall and projection bases.
 4. Install base flashing ply to all perimeter and projection details.
 5. Allow the one ply of base sheet to cure at least 30 minutes before installing the modified membrane. However, the modified membrane must be installed the same day as the base plies.
- B. Modified Cap Ply: Solidly bond the modified membrane to the base layers with specified material at the rate of 25 to thirty 30 lbs. (11-13kg) per 100 square feet.
1. Roll must push a puddle of hot material in front of it with material slightly visible at all side laps. Use care to eliminate air entrapment under the membrane. Exercise care during application to eliminate air entrapment under the membrane.
 2. Apply pressure to all seams to ensure that the laps are solidly bonded to substrate.
 3. Install subsequent rolls of modified membrane as above with a minimum of 4 inch (101 mm) side laps and 8 inch (203 mm) end laps. Stagger end laps. Apply membrane in the same direction as the previous layers but stagger the laps so they do not coincide with the laps of the base layers.
 4. Apply hot material no more than 5 feet (1.5 m) ahead of each roll being embedded.
 5. Extend membrane 2 inches (50 mm) beyond top edge of all cants in full moppings of the specified asphalt.
- C. Fibrous Cant Strips: Provide non-combustible cant strips at all wall/curb detail treatments where angle changes are greater than 45 degrees. Cant may be set in approved cold adhesives, hot asphalt or mechanically attached with approved plates and fasteners.
- D. Wood Blocking, Nailers and Cant Strips: Provide wood blocking, nailers and cant strips as specified.
1. Provide nailers at all roof perimeters and penetrations (as required by primary roofing manufacturer) for fastening membrane flashings and sheet metal components.
 2. Wood nailers should match the height of any insulation, providing a smooth and even transition between flashing and insulation areas.
 3. Nailer lengths should be spaced with a minimum 1/8 inch gap for expansion and contraction between each length or change of direction.
 4. Nailers and flashings should be fastened in accordance with Factory Mutual "Loss Prevention Data Sheet 1- 49, Perimeter Flashing."
- E. Metal Work: Provide new metal flashings, counter flashings, and parapet coping caps. Install in accordance with the SMACNA "Architectural Sheet Metal Manual" or the NRCA Roofing Waterproofing manual, finish to match existing.
- F. Termination Bar: Provide a metal termination bar or approved top edge securement at the terminus of all flashing sheets at walls and curbs. Fasten the bar a minimum of 8 inches (203 mm) o/c through butyl tape to achieve constant compression. Provide suitable, sealant at the top edge if required.

- G. Flashing Base Ply General:
1. Seal curb, wall and parapet flashings with an application of mastic and mesh on a daily basis. Do not permit conditions to exist that will allow moisture to enter behind, around or under the roof or flashing membrane.
 2. Prepare all walls, penetrations, expansion joints and surfaces to be flashed with required primer at the rate of 100 square feet per gallon. Allow primer to dry tack free.
 3. Extend flashing base ply four inches above cant and four inches below cant.
 4. Solidly adhere the entire sheet of flashing base ply membrane to the substrate.
 5. Coordinate counter flashing, cap flashings, expansion joints, and similar work with modified bitumen roofing work as specified.
 6. Coordinate roof accessories, miscellaneous sheet metal accessory items, including piping vents and other devices with the roofing system work.
- H. Flashing Cap Ply General:
1. Seal curb, wall and parapet flashings with an application of mastic and mesh on a daily basis. Do not permit conditions to exist that will allow moisture to enter behind, around or under the roof or flashing membrane.
 2. Prepare all walls, penetrations, expansion joints and where shown on the Drawings to be flashed with required primer at the rate of 100 square feet per gallon. Allow primer to dry tack free.
 3. Adhere the flashing cap ply with specified adhesive. Nail off at a minimum of 8 inches (203 mm) o.c. from the finished roof at all vertical surfaces. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow to cure before coating.
 4. Coordinate counter flashing, cap flashings, expansion joints and similar work with modified bitumen roofing work as specified.
 5. Coordinate roof accessories, miscellaneous sheet metal accessory items with the roofing system work.
 6. Secure the top edge of the flashing sheet using a termination bar only when the wall surface above is waterproofed, or nailed 4 inches on center and covered with an acceptable counter flashing.
- I. Surface Coatings: Apply roof coating in strict conformance with the manufacturer's recommended procedures.
1. Remove dust, dirt, debris and excess roofing granules from field and base flashings receiving coating.
 2. Install 2.5 gallons per square (1.25 gal per coat, two coat application) in a cross hatch manner of specified acrylic white energy star coating to all field, wall and penetrations.

3.6 INSTALLATION EDGE TREATMENT AND ROOF PENETRATION FLASHING

- A. Metal Edge:
1. Inspect the nailers to assure proper attachment and configuration.
 2. Run one ply over the edge. Assure coverage of all wood nailers. Fasten plies with ring shank nails at 8 inches (203 mm) o.c.
 3. Install continuous cleat and fasten at 6 inches (152 mm) o.c.
 4. Install new metal edge hooked to continuous cleat and set in bed of roof cement. Fasten flange to wood nailers every 3 inches (76 mm) o.c. staggered.
 5. Prime metal edge at a rate of 100 square feet per gallon and allow to dry.
 6. Strip in flange with base flashing ply covering entire flange in bitumen with 6 inches (152 mm) on to the field of roof. Assure ply laps do not coincide with metal laps.

7. Install a second ply of modified flashing ply in bitumen over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Seal outside edge with rubberized cement.
- B. Roof Edge with Gutter:
1. Inspect the nailer to assure proper attachment and configuration. Increase slope at metal edge by additional degree of slope in first board.
 2. Run one ply over the edge. Assure coverage of all wood nailers. Fasten plies with ring shank nails at 8 inches (203 mm) o.c.
 3. Install gutter and strapping.
 4. Install continuous cleat and fasten at 6 inches (152 mm) o.c.
 5. Install new metal edge hooked to continuous cleat and set in bed of roof cement. Fasten flange to wood nailer every 3 inches (76 mm) o.c. staggered.
 6. Prime metal edge at a rate of 100 square feet per gallon and allow to dry.
 7. Strip in flange with base flashing ply covering entire flange in bitumen with 6 inches (152 mm) onto the field of the roof. Assure ply laps do not coincide with metal laps.
 8. Install a second ply of modified flashing ply in bitumen over the base flashing ply, 9 inches (228 mm) on to the field of the roof.
- C. Scupper Through Wall:
1. Inspect the nailer to assure proper attachment and configuration.
 2. Run one ply over nailer, into scupper hole and up flashing as in typical wall flashing detail. Assure coverage of all wood nailers.
 3. Install a scupper box in a 1/4 inch (6 mm) bed of mastic. Assure all box seams are soldered and have a minimum 4 inch (101 mm) flange. Make sure all corners are closed and soldered. Prime scupper at a rate of 100 square feet per gallon and allow to dry.
 4. Fasten flange of scupper box every 3 inches (76 mm) o.c. staggered.
 5. Strip in flange of scupper box with base flashing ply covering entire area with 6 inch (152 mm) overlap on to the field of the roof and wall flashing.
 6. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
- D. Scupper Through Wall (Overflow):
1. Inspect the nailer to assure proper attachment and configuration.
 2. Run one ply over nailer up the overflow, into the scupper hole and up flashing as in typical wall flashing detail. Assure coverage of all wood nailers.
 3. Install scupper box in a 1/4 inch (6 mm) bed of mastic. Assure all box seams are soldered and have a minimum 4 inch (101 mm) flange. Make sure all corners are closed and soldered. Prime scupper at a rate of 100 square feet per gallon and allow to dry.
 4. Fasten flange of scupper box every 3 inches (76 mm) o.c. staggered.
 5. Strip in flange scupper box with base flashing ply covering entire area with 6 inch (152 mm) overlap on to the field of the roof and wall flashing.
 6. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
- E. Coping Cap:

1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install continuous cleat and fasten at 6 inches (152 mm) o.c. to outside wall.
 6. Install new metal coping cap hooked to continuous cleat.
 7. Fasten inside cap 24 inches (609 mm) o.c. with approved fasteners and neoprene washers through slotted holes, which allow for expansion and contraction.
- F. Surface Mounted Counterflashing/Coping Cap:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Apply butyl tape to wall behind flashing. Secure termination bar through flashing, butyl tape and into wall. Alternatively use caulk to replace the butyl tape.
 6. Secure counterflashing set on butyl tape above flashing. Fasten 8 inches (203 mm) o.c. and caulk top of counterflashing.
 7. Cover tapered board and all exposed wood with base flashing ply. Fasten inside and out at 8 inches (203 mm) o.c.
 8. Install continuous cleat and fasten at 6 inches (152 mm) o.c. to outside wall.
 9. Install new metal coping cap hooked to continuous cleat.
 10. Fasten inside of cap 24 inch (609 mm) o.c. with approved fasteners and neoprene washers.
- G. Surface Mounted Counterflashing:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Apply butyl tape to wall behind flashing. Secure termination bar through flashing, butyl tape and into wall. Alternatively use caulk to replace the butyl tape.
 6. Secure counterflashing set on butyl tape above flashing at 8 inches (203 mm) o.c. and caulk top of counterflashing.

- H. Reglet Mounted Counterflashing:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Apply butyl tape to wall behind flashing. Secure termination bar through flashing, butyl tape and into wall. Alternatively use caulk to replace the butyl tape.
 6. Cut reglet in masonry one joint above flashing.
 7. Secure reglet counterflashing with expansion fasteners and caulk reglet opening.
- I. Expansion Joint:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured expansion joint cover. Fasten sides at 12 inches (609 mm) o.c. with fasteners and neoprene washers. Furnish all joint cover laps with butyl tape between metal covers.
- J. Area Divider:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured cover. Fasten sides at 24 inches (609 mm) o.c. with fasteners and neoprene washers through slotted holes. Furnish all joint cover laps with butyl tape between metal covers.
- K. Equipment Support:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane,

- in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
5. Install pre-manufactured cover. Fasten sides at 24 inches (609 mm) o.c. with fasteners and neoprene washers. Furnish all joint cover laps with butyl tape between metal covers.
 6. Set equipment on neoprene pad and fasten as required by equipment manufacturer.
- L. Curb Detail/Air Handling Station:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured counterflashing with fasteners and neoprene washers or per manufacturer's recommendations.
 6. Set equipment on neoprene pad and fasten as required by equipment manufacturer.
- M. Skylight:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured lens and fasten flashing sides at 8 inches (203 mm) o.c. with fasteners and neoprene washers.
- N. Pre-manufactured Curb for Equipment Support:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install pre-manufactured cover. Fasten sides at 24 inches (609 mm) o.c. with fasteners and neoprene washers. Furnish all joint cover laps with butyl tape between metal covers.
 6. Set equipment on neoprene pad and fasten as required by equipment manufacturer.

- O. Exhaust Fan:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install metal exhaust fan over the wood nailers and flashing to act as counterflashing. Fasten per manufacturer's recommendation.
- P. Passive Vent/Air Intake:
1. Minimum flashing height is 8 inches (203 mm) above finished roof height. Prime vertical wall at a rate of 100 square feet per gallon and allow to dry.
 2. Set cant in bitumen. Run all field plies over cant a minimum of 2 inches (50 mm).
 3. Install base flashing ply, extend sheet 4 inches above top of cant and down face with 4 inches on to field of roof.
 4. Install base flashing surfacing ply, 60 mil POLIMER REINFORCED PVC membrane, in bitumen or low rise adhesive over the base flashing ply, 9 inches (228 mm) on to the field of the roof. Heat-weld all side laps. Three-course with an application of mastic, mesh and granules at transition on field of roof. Allow too cure before coating.
 5. Install passive vent/air intake over the wood nailers and flashing to act as counterflashing. Fasten per manufacturer's recommendations.
- Q. Roof Drain:
1. Plug drain to prevent debris from entering plumbing.
 2. Taper insulation to drain minimum of 24 inches (609 mm) from center of drain.
 3. Run roof system plies over drain. Cut out plies inside drain bowl.
 4. Set lead flashing (30 inch square minimum) in 1/4 inch bed of mastic. Run lead into drain a minimum of 2 inches (50 mm). Prime lead at a rate of 100 square feet per gallon and allow to dry.
 5. Install base flashing ply (40 inch square minimum) in bitumen.
 6. Install modified membrane (48 inch square minimum) in bitumen.
 7. Install clamping ring and assure that all plies are under the clamping ring.
 8. Remove drain plug and install strainer.
- R. Plumbing Stack & Cylinder Supports:
1. Minimum stack height is 12 inches (609 mm).
 2. Run roof system over the entire surface of the roof. Seal the base of the stack with elastomeric sealant.
 3. Prime flange of new sleeve. Install properly sized sleeves set in 1/4 inch (6 mm) bed of roof cement.
 4. Install base flashing ply in bitumen.
 5. Install membrane in bitumen.
 6. Caulk the intersection of the membrane with elastomeric sealant.
 7. Turn sleeve a minimum of 1 inch (25 mm) down inside of stack.
- S. Heat Stack:
1. Minimum stack height is 12 inches (609 mm).

2. Run roof system over the entire surface of the roof. Seal the base of the stack with elastomeric sealant.
 3. Prime flange of new sleeve. Install properly sized sleeves set in 1/4 inch (6 mm) bed of roof cement.
 4. Install base flashing ply in bitumen.
 5. Install modified membrane in bitumen.
 6. Caulk the intersection of the membrane with elastomeric sealant.
 7. Install new collar over cape. Weld collar or install stainless steel draw brand.
- T. Liquid Flashing:
1. Mask target area on roof membrane with tape.
 2. Clean all non-porous areas with isopropyl alcohol.
 3. Apply 32 wet mil base coat of liquid flashing over masked area.
 4. Embed polyester reinforcement fabric into the base coat of the liquid flashing.
 5. Apply 48-64 wet mil top coat of the liquid flashing material over the fabric extending 2 inches (51 mm) past the scrim in all directions.
 6. Apply minerals immediately or allow the liquid flashing material to cure 15-30 days and then install reflective coating.

3.7 PROTECTION

- A. Provide traffic ways, erect barriers, fences, guards, rails, enclosures, chutes and the like to protect personnel, roofs and structures, vehicles and utilities.
- B. Protect exposed surfaces of finished walls with tarps to prevent damage.
- C. Special permission shall be obtained from the Manufacturer before any traffic shall be permitted over new roofing.

3.8 FIELD QUALITY CONTROL

- A. Inspection: Provide manufacturer's field observations at a minimum of one (1) time a week.
- B. Warranty shall be issued upon manufacturer's acceptance of the installation and the from the completion date listed on the certificate of completion.
- C. Field observations shall be performed by the Technical Representative contracted by or employed by the manufacturer, and whose primary job description is to assist, inspect and approve membrane installations for the manufacturer.
- D. Provide observation reports from the Technical Representative upon each site visit including electronic, written and photo documentation. These reports must me sent to the Architect after each inspection.
- E. Provide a final report from the Technical Representative, certifying that the roofing system has been satisfactorily installed according to the project specifications, approved details and good general roofing practice.

END OF SECTION

SECTION 07 62 00

SHEET METAL FLASHING AND TRIM

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fabricated sheet metal items, including flashings, counterflashings, and downspouts.
- B. Cleaning and repair of existing gutters.

1.02 REFERENCES

- A. ASTM A 653/A 653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2005a.
- B. ASTM D 4586 - Standard Specification for Asphalt Roof Cement, Asbestos-Free; 2000.
- C. SMACNA (ASMM) - Architectural Sheet Metal Manual; Sheet Metal and Air Conditioning Contractors' National Association; 2003.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate material profile, jointing pattern, jointing details, fastening methods, flashings, terminations, and installation details.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA Architectural Sheet Metal Manual requirements and standard details, except as otherwise indicated.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Stack material to prevent twisting, bending, and abrasion, and to provide ventilation. Slope metal sheets to ensure drainage.
- B. Prevent contact with materials which may cause discoloration or staining.

PART 2 PRODUCTS

2.01 SHEET MATERIALS

- A. Galvanized Steel: ASTM A 653/A 653M, with G90/Z275 zinc coating; minimum 0.02 inch thick base metal.

2.02 ACCESSORIES

- A. Fasteners: Galvanized steel, with soft neoprene washers.
- B. Primer: Zinc chromate type.
- C. Protective Backing Paint: Zinc molybdate alkyd.
- D. Sealant: Silicone as specified in Section 07 90 05.
- E. Plastic Cement: ASTM D 4586, Type I.

2.03 FABRICATION

- A. Form sections true to shape, accurate in size, square, and free from distortion or defects.
- B. Form pieces in longest possible lengths.

- C. Hem exposed edges on underside 1/2 inch; miter and seam corners.
- D. Form material with flat lock seams, except where otherwise indicated. At moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- E. Fabricate corners from one piece with minimum 18 inch long legs; seam for rigidity, seal with sealant.
- F. Fabricate vertical faces with bottom edge formed outward 1/4 inch and hemmed to form drip.
- G. Fabricate flashings to allow toe to extend 2 inches over roofing gravel. Return and brake edges.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify roof openings, curbs, pipes, sleeves, ducts, and vents through roof are solidly set, reglets in place, and nailing strips located.
- B. Verify roofing termination and base flashings are in place, sealed, and secure.

3.02 PREPARATION

- A. Install starter and edge strips, and cleats before starting installation.
- B. Back paint concealed metal surfaces with protective backing paint to a minimum dry film thickness of 15 mil.

3.03 INSTALLATION

- A. Secure flashings in place using concealed fasteners. Use exposed fasteners only where permitted.
- B. Apply plastic cement compound between metal flashings and felt flashings.
- C. Fit flashings tight in place. Make corners square, surfaces true and straight in planes, and lines accurate to profiles.
- D. Seal metal joints watertight.
- E. Clean existing gutters and prepare for field painting.
- F. Secure existing gutters and downspouts in place using fasteners.

END OF SECTION

SECTION 07 71 00
ROOF SPECIALTIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Manufactured roof specialties, including copings, fascias, and gravel stops.

1.02 REFERENCES

- A. ASTM D 4586 - Standard Specification for Asphalt Roof Cement, Asbestos-Free; 2000.
- B. SMACNA (ASMM) - Architectural Sheet Metal Manual; Sheet Metal and Air Conditioning Contractors' National Association; 2003.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on shape of components, materials and finishes, anchor types and locations.

1.04 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA Architectural Sheet Metal Manual details.

PART 2 PRODUCTS

2.01 COMPONENTS

- A. Copings: Extruded aluminum, 0.050 inch thick, shaped as indicated, including special supports spaced at 24 inches on center. Include cover plates to conceal and weather seal joints and attachment flanges.
 - 1. Finish: Mill finish.

2.02 ACCESSORIES

- A. Roof Cement: ASTM D 4586, Type II.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that deck, curbs, roof membrane, base flashing, and other items affecting work of this Section are in place and positioned correctly.

3.02 INSTALLATION

- A. Install components in accordance with manufacturer's instructions.
- B. Coordinate installation of components of this section with installation of roofing membrane and base flashings.
- C. Coordinate installation of sealants and roofing cement with work of this section to ensure water tightness.

END OF SECTION

SECTION 07 90 05

JOINT SEALERS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Sealants and joint backing.

1.02 REFERENCES

- A. ASTM C 834 - Standard Specification for Latex Sealants; 2005.
- B. ASTM C 919 - Standard Practice for Use of Sealants in Acoustical Applications; 2002.
- C. ASTM C 920 - Standard Specification for Elastomeric Joint Sealants; 2005.
- D. ASTM C 1193 - Standard Guide for Use of Joint Sealants; 2005a.
- E. SCAQMD 1168 - South Coast Air Quality Management District Rule No.1168; current edition; www.aqmd.gov.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data indicating sealant chemical characteristics and color availability.

1.04 ENVIRONMENTAL REQUIREMENTS

- A. Maintain temperature and humidity recommended by the sealant manufacturer during and after installation.

1.05 COORDINATION

- A. Coordinate the work with all sections referencing this section.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective work within a five year period after Date of Substantial Completion.
- C. Warranty: Include coverage for installed sealants and accessories which fail to achieve airtight seal, exhibit loss of adhesion or cohesion, or do not cure.

PART 2 PRODUCTS

2.01 SEALANTS

- A. Sealants and Primers - General: Provide only products having lower volatile organic compound (VOC) content than required by the more stringent of the South Coast Air Quality Management District Rule No.1168.
- B. Type ES-1 - General Purpose Exterior Sealant: Polyurethane; ASTM C 920, Grade NS, Class 25, Uses M, G, and A; single component.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Applications: Use for:
 - a. Joints between metal frames and other materials.
 - b. Other exterior joints for which no other sealant is indicated.

- C. Type ES-2 - General Purpose Interior Sealant: Acrylic emulsion latex; ASTM C 834, Type OP, Grade NF single component, paintable.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Applications: Use for:
 - a. Interior wall and ceiling control joints.
 - b. Joints between door and window frames and wall surfaces.
 - c. Other interior joints for which no other type of sealant is indicated.
- D. Type ES-3 - Bathtub/Tile Sealant: White silicone; ASTM C 920, Uses I, M and A; single component, mildew resistant.
 - 1. Applications: Use for:
 - a. Joints between plumbing fixtures and floor and wall surfaces.
 - b. Joints between kitchen and bath countertops and wall surfaces.
- E. Type ES-4 - Acoustical Sealant: Butyl or acrylic sealant; ASTM C 920, Grade NS, Class 12-1/2, Uses M and A; single component, solvent release curing, non-skinning.
 - 1. Applications: Use for concealed locations only:
 - a. Sealant bead between top plate and structure and between sill plate and floor.
- F. Type ES-5 - Silicone Sealant: ASTM C 920, Grade NS, Class 25, Uses NT, A, G, M, O; single component, solvent curing, non-sagging, non-staining, fungus resistant, non-bleeding.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Movement Capability: Plus and minus 25 percent.
 - 3. Service Temperature Range: -65 to 180 degrees F.
 - 4. Shore A Hardness Range: 15 to 35.
 - 5. Applications: Use for:
 - a. Joints between pre-finished flashings and copings.

2.02 ACCESSORIES

- A. Primer: Non-staining type, recommended by sealant manufacturer to suit application.
- B. Joint Cleaner: Non-corrosive and non-staining type, recommended by sealant manufacturer; compatible with joint forming materials.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate surfaces are ready to receive work.
- B. Verify that joint backing and release tapes are compatible with sealant.

3.02 PREPARATION

- A. Remove loose materials and foreign matter which might impair adhesion of sealant.
- B. Clean and prime joints in accordance with manufacturer's instructions.
- C. Perform preparation in accordance with manufacturer's instructions and ASTM C 1193.
- D. Protect elements surrounding the work of this section from damage or disfigurement.

3.03 INSTALLATION

- A. Perform work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Perform installation in accordance with ASTM C 1193.
- C. Perform acoustical sealant application work in accordance with ASTM C 919.
- D. Install sealant free of air pockets, foreign embedded matter, ridges, and sags.

- E. Apply sealant within recommended application temperature ranges. Consult manufacturer when sealant cannot be applied within these temperature ranges.

3.04 CLEANING

- A. Clean adjacent soiled surfaces.

3.05 PROTECTION OF FINISHED WORK

- A. Protect sealants until cured.

END OF SECTION

SECTION 09 90 00

PAINTING AND COATING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Surfaces to be finished are indicated in this section and on the Drawings.

1.02 REFERENCES

- A. 40 CFR 59, Subpart D - National Volatile Organic Compound Emission Standards for Architectural Coatings; U.S. Environmental Protection Agency; current edition.
- B. MPI (APL) - Master Painters Institute Approved Products List; Master Painters and Decorators Association; current edition, www.paintinfo.com.
- C. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Master Painters and Decorators Association; 2004.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of all products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").
 - 2. MPI product number (e.g. MPI #47).
 - 3. Cross-reference to specified paint system(s) product is to be used in; include description of each system (copy of relevant MPI Manual page is acceptable).
- C. Samples: Submit three paper "drop" samples, 8-1/2 by 11 inches in size, illustrating range of colors available for each finishing product specified.
 - 1. Where sheen is specified, submit samples in only that sheen.
 - 2. Where sheen is not specified, discuss sheen options with Architect before preparing samples, to eliminate sheens definitely not required.

1.04 QUALITY ASSURANCE

- A. Material Safety Data Sheets: At project site maintain file of MSDS sheets for each product used; become familiar with and follow manufacturer's stated application and safety requirements.
 - 1. Submit copies of MSDS sheets to Owner.

1.05 MOCK-UP

- A. See Section 01 40 00 - Quality Requirements, for general requirements for mock-up.
- B. Provide wall panel, 8 feet long by 8 feet wide, illustrating coating color, texture, and finish.
- C. Provide door and frame assembly illustrating coating color, texture, and finish.
- D. Locate where directed.
- E. Mock-up may remain as part of the Work.

1.06 DELIVERY, STORAGE, AND PROTECTION

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.

- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F and a maximum of 90 degrees F, in ventilated area, and as required by manufacturer's instructions.

1.07 ENVIRONMENTAL REQUIREMENTS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Minimum Application Temperatures for Latex Paints: 45 degrees F for interiors; 50 degrees F for exterior; unless required otherwise by manufacturer's instructions.
- D. Provide lighting level of 80 ft candles measured mid-height at substrate surface.

1.08 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Supply 1 gallon of each color; store where directed.
- C. Label each container with color in addition to the manufacturer's label.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide all paint and coating products used in any individual system from the same manufacturer; no exceptions.
- B. Provide all paint and coating products from the same manufacturer to the greatest extent possible.

2.02 MATERIALS - GENERAL

- A. Volatile Organic Compound (VOC) Content:
 - 1. Provide coatings that comply with the most stringent requirements specified in the following:
 - a. 40 CFR 59, Subpart D--National Volatile Organic Compound Emission Standards for Architectural Coatings.
 - 2. Determination of VOC Content: Testing and calculation in accordance with 40 CFR 59, Subpart D (EPA Method 24), exclusive of colorants added to a tint base and water added at project site; or other method acceptable to authorities having jurisdiction.
- B. Paints and Coatings: Provide products listed in Master Painters Institute Approved Product List, current edition available at www.paintinfo.com, for specified MPI Categories, except as otherwise indicated.
 - 1. Provide ready mixed paints and coatings, except field-catalyzed coatings.
 - 2. Provide materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.

2.03 PAINT SYSTEMS

- A. Provide Premium Grade systems (2 top coats) as defined in MPI Architectural Painting Specification Manual, except as otherwise indicated.

- B. Where a specified paint system does not have a Premium Grade, provide Custom Grade system.
- C. Where sheen is not specified or more than one sheen is specified, sheen will be selected later by Architect from the manufacturer's full line.
- D. Provide colors as directed by Architect.

2.04 EXTERIOR PAINT SYSTEMS

- A. Galvanized Metal, Not Chromate Passivated:
 1. Applications include but are not limited to doors.
 2. EXT 5.3J W.B. Light Industrial Coating: W.B. Primer MPI #134, W.B. Light Industrial Coating MPI #110, gloss level 5.
- B. Aluminum:
 1. EXT 5.4G W.B. Light Industrial Coating: Q.D. Primer MPI #95, W.B. Light Industrial Coating MPI #110, gloss level 5.
- C. Stucco Walls and Soffits: Match existing color and paint type from one of the following selections:
 1. EXT 9.1A Latex: Latex MPI #10, 11 or 119, semi-gloss.
 2. EXT 9.1B W.B. Light Industrial Coating: W.B. Light Industrial Coating MPI #110, gloss level 5.
 3. EXT 9.1C Elastomeric: Elastomeric MPI #113, semi-gloss.

2.05 INTERIOR PAINT SYSTEMS

- A. Gypsum Board:
 1. Applications include but are not limited to walls, ceilings, and soffits.
 2. INT 9.2A Latex: Latex Primer Sealer MPI #50, Latex #43, 44, 52, 53, 54 or 114, Gloss level 4.

PART 3 EXECUTION

3.01 SCOPE -- SURFACES TO BE FINISHED

- A. Paint all exposed surfaces except where indicated not to be painted or to remain natural; the term "exposed" includes areas visible through permanent and built-in fixtures when they are in place.
- B. Paint the surfaces described in PART 2, indicated on the Drawings, and as follows:
 1. If a surface, material, or item is not specifically mentioned, paint in the same manner as similar surfaces, materials, or items, regardless of whether colors are indicated or not.
 2. Paint surfaces behind movable equipment and furnishings the same as similar exposed surfaces.
 3. Paint surfaces to be concealed behind permanently installed fixtures, equipment, and furnishings, using primer only, prior to installation of the permanent item.
 4. Paint back sides of access panels and removable and hinged covers to match exposed surfaces.
 5. Finish top, bottom, and side edges of exterior doors the same as exposed faces.
 6. Paint all insulated and exposed pipes, conduit, boxes, insulated and exposed ducts, hangers, brackets, collars and supports, mechanical equipment, and electrical equipment occurring in finished areas to match background surfaces, unless otherwise indicated.
 7. Paint shop-primed mechanical and electrical items occurring in finished areas.
 8. Paint interior surfaces of air ducts and convector and baseboard heating cabinets with flat, nonspecular black paint where visible through registers, grilles, or louvers.

9. Paint dampers exposed behind louvers, grilles, and convector and baseboard cabinets to match face panels.
- C. Do Not Paint or Finish the Following Items:
1. Items fully factory-finished unless specifically noted; factory-primed items are not considered factory-finished.
 2. Items indicated to receive other finish.
 3. Items indicated to remain naturally finished.
 4. Fire rating labels, equipment serial number and capacity labels, and operating parts of equipment.

3.02 EXAMINATION

- A. Verify that surfaces are ready to receive Work as instructed by the product manufacturer.
- B. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- C. Test shop-applied primer for compatibility with subsequent cover materials; report incompatible primer conditions and submit recommended changes for Architect's approval.
- D. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces are below the following maximums:
 1. Plaster and Gypsum Board: 12 percent.

3.03 PREPARATION

- A. Prepare surfaces as specified in MPI Architectural Painting Specification Manual and as follows for the applicable surface and coating; if multiple preparation treatments are specified, use as many as necessary for best results; where the Manual references external standards for preparation (e.g. SSPC standards), prepare as specified in those standards; comply with coating manufacturer's specific preparation methods or treatments, if any.
- B. Coordinate painting work with cleaning and preparation work so that dust and other contaminants do not fall on newly painted, wet surfaces.
- C. Surface Appurtenances: Prior to preparing surfaces or finishing, remove electrical plates, hardware, light fixtures, light fixture trim, escutcheons, machined surfaces, fittings, and similar items already installed that are not to be painted.
 1. If removal is impractical or impossible because of the size or weight of the item, provide surface-applied protection before preparation and finishing.
 2. After completing painting in each space or area, reinstall items removed using workers skilled in the trades involved.
- D. Surfaces: Correct defects and clean surfaces which affect work of this section. Remove or repair existing coatings that exhibit surface defects.
- E. Marks: Seal with shellac those which may bleed through surface finishes.
- F. Impervious Surfaces: Remove mildew by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- G. Gypsum Board Surfaces to be Painted: Fill minor defects with filler compound. Spot prime defects after repair.
- H. Plaster Surfaces to be Painted: Fill hairline cracks, small holes, and imperfections with latex patching plaster. Make smooth and flush with adjacent surfaces. Wash and neutralize high alkali surfaces.
- I. Aluminum Surfaces to be Painted: Remove surface contamination by steam or high pressure water. Remove oxidation with acid etch and solvent washing. Apply etching primer immediately following cleaning.

- J. Galvanized Surfaces to be Painted: Remove surface contamination and oils and wash with solvent. Apply coat of etching primer.

3.04 APPLICATION

- A. Apply products in accordance with manufacturer's instructions and as specified or recommended by MPI Manual, using the preparation, products, sheens, textures, and colors as indicated.
 - 1. Remove, refinish, or repaint work not complying with requirements.
- B. Do not apply finishes over dirt, rust, scale, grease, moisture, scuffed surfaces, or other conditions detrimental to formation of a durable coating film; do not apply finishes to surfaces that are not dry.
- C. Use applicators and methods best suited for substrate and type of material being applied and according to manufacturer's instructions.
 - 1. Brush Application: Use brushes best suited for the type of material applied; use brush of appropriate size for the surface or item being painted; produce results free of visible brush marks.
 - 2. Roller Application: Use rollers of carpet, velvet back, or high-pile sheep's wool as recommended by manufacturer for material and texture required.
 - 3. Spray Application: Use airless spray equipment with orifice size as recommended by manufacturer for material and texture required.
 - 4. Where application method is listed in the MPI Manual for the paint system that application method is required; otherwise any application method recommended by manufacturer for material used and objects to be painted is acceptable.
- D. Minimum Coating Thickness: Apply paint materials no thinner than manufacturer's recommended spreading rate; provide total dry film thickness of entire system as recommended by manufacturer.
 - 1. Number of coats and film thickness required are the same regardless of application method.
 - 2. If undercoats, stains, or other conditions show through final coat of paint, apply additional coats until paint film is of uniform finish, color, and appearance.
 - 3. Give special attention to ensure edges, corners, crevices, welds, and exposed fasteners receive dry film thickness equivalent to that of flat surfaces.
- E. Apply finish to completely cover surfaces with uniform appearance without brush marks, runs, sags, laps, ropiness, holidays, spotting, cloudiness, or other surface imperfections.
 - 1. Before applying finish coats, apply a prime coat of material recommended by manufacturer, unless the surface has been prime coated by others; where evidence of suction spots or unsealed areas in first coat appear, recoat primed and sealed surfaces to ensure finish coat with no burn through or other defects due to insufficient sealing.
 - 2. Apply first coat to surface that has been cleaned, pretreated, or otherwise prepared as soon as practical after preparation and before subsequent surface deterioration.
 - 3. Do not apply succeeding coats until the previous coat has cured as recommended by manufacturer.
 - 4. Do not recoat until paint has dried to where it feels firm, does not deform or feel sticky under moderate thumb pressure, and application of another coat will not cause the undercoat to lift or lose adhesion.
 - 5. If manufacturer's instructions recommend sanding to produce a smooth, even surface, sand between coats.
 - 6. Before applying next coat vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.

3.05 CLEANING AND PROTECTION

- A. Collect waste material which may constitute a fire hazard, place in closed metal containers, and remove daily from site.

- B. At the end of each workday, remove empty cans, rags, rubbish, and other discarded paint materials from site.
- C. Protect other work, whether being painted or not, against damage by painting. Correct damage by cleaning, repairing or replacing, and repainting as approved by Architect.
- D. Provide "Wet Paint" signs to protect newly painted finishes. Remove temporary protective wrappings provided by others to protect their work after completing painting operations.
- E. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces. Comply with procedures specified in MPI Manual.

END OF SECTION